



MESURA
METERING

A Cavagna Group Company



M21

UA.TR.001

ДСТУ EN 1359:2012

AG4

0 0 0 0 0 1 2 **m³**

Qmax: 6 m³/h Qmin: 0,04 m³/h Qt: 0,6 m³/h Pmax: 0,5 bar
V: 1,2 dm³ 1 imp = 0,01 m³ Tm = мінус 25°C — 55°C M1

Клас 1,5

Серійний № **00102495**

Рік виготовлення: **2021**



00102495





СИГНАЛІЗАТОР
ГАЗУ




ЛЕЛЕКА

МЕТАН
ОКИС ВУГЛЕЦЮ



CH₄ CO





IHTEPHET
veko.in.ua
093 080 7875
068 445 4151
0432 62-11-72
Box#





1







2021

USA 718 001
M21

0000000000

0000000000

MTK-UA


Q₃ 16 m³/h

H R80

MAP 16

T50



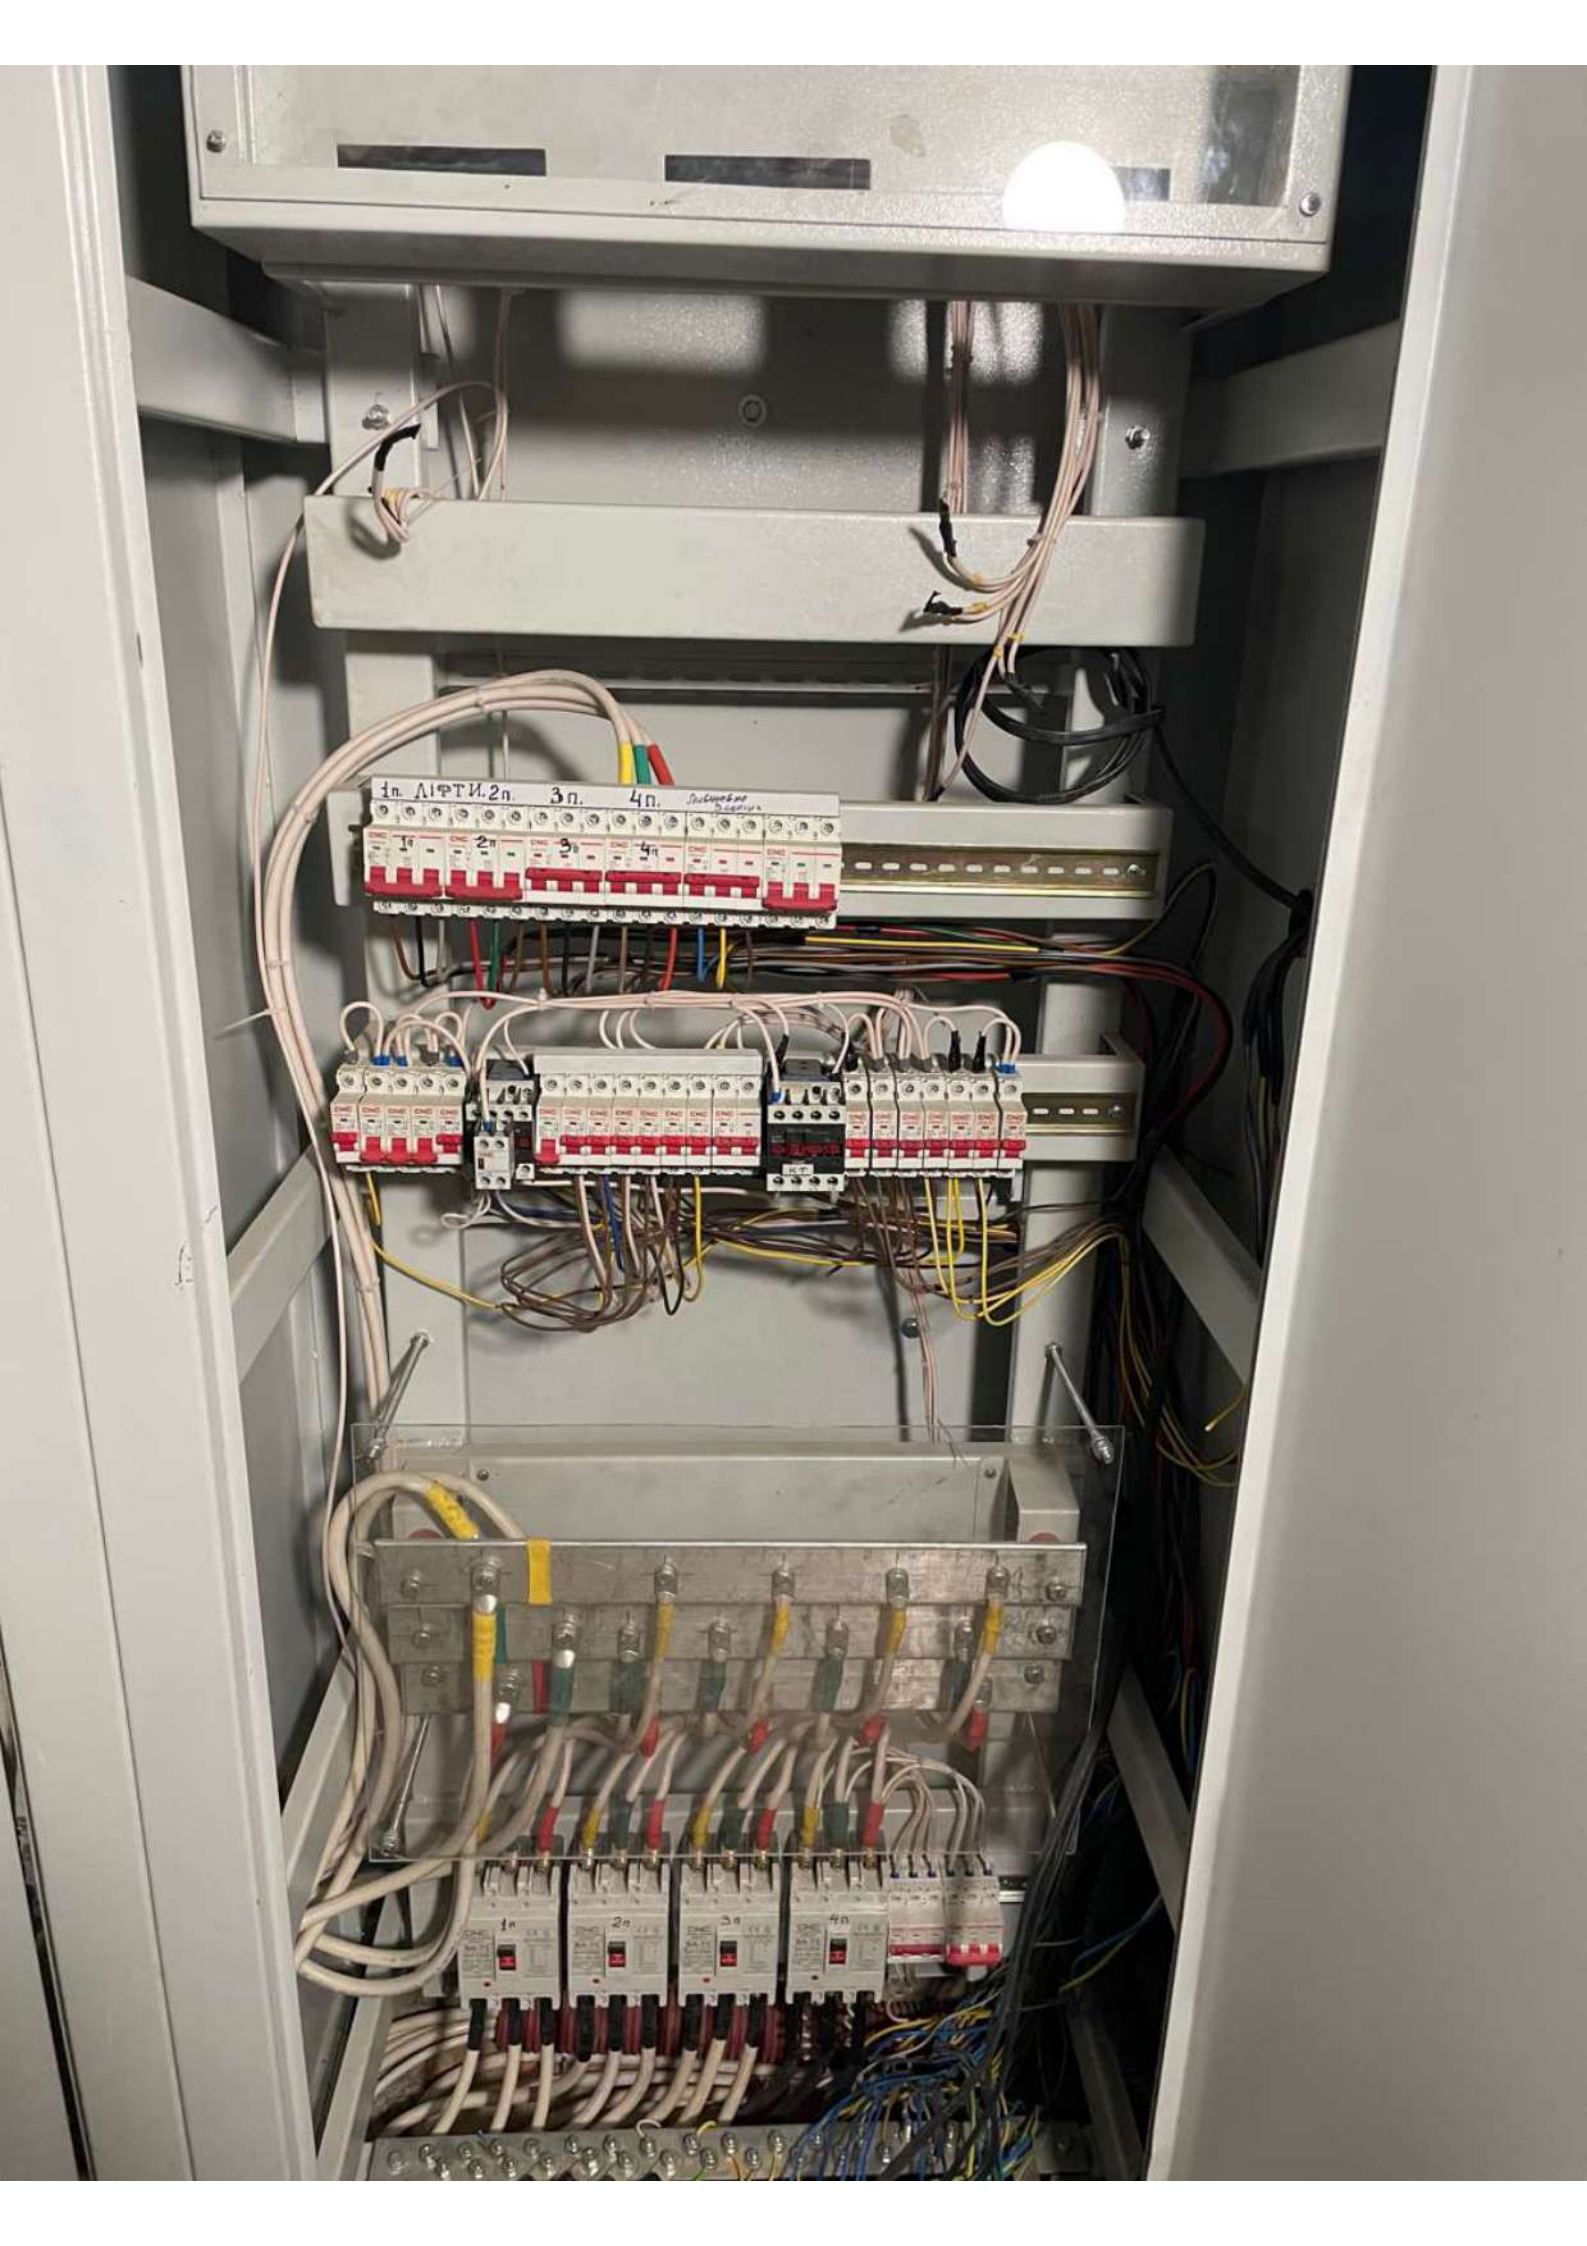

1п. ЛПТИ. 2п. 3п. 4п. Сигнальные устройства

1п. 2п. 3п. 4п.


1п. 2п. 3п. 4п.




TOP
Date: 2011
W.S.S.

2011-1-10
W.S.S.



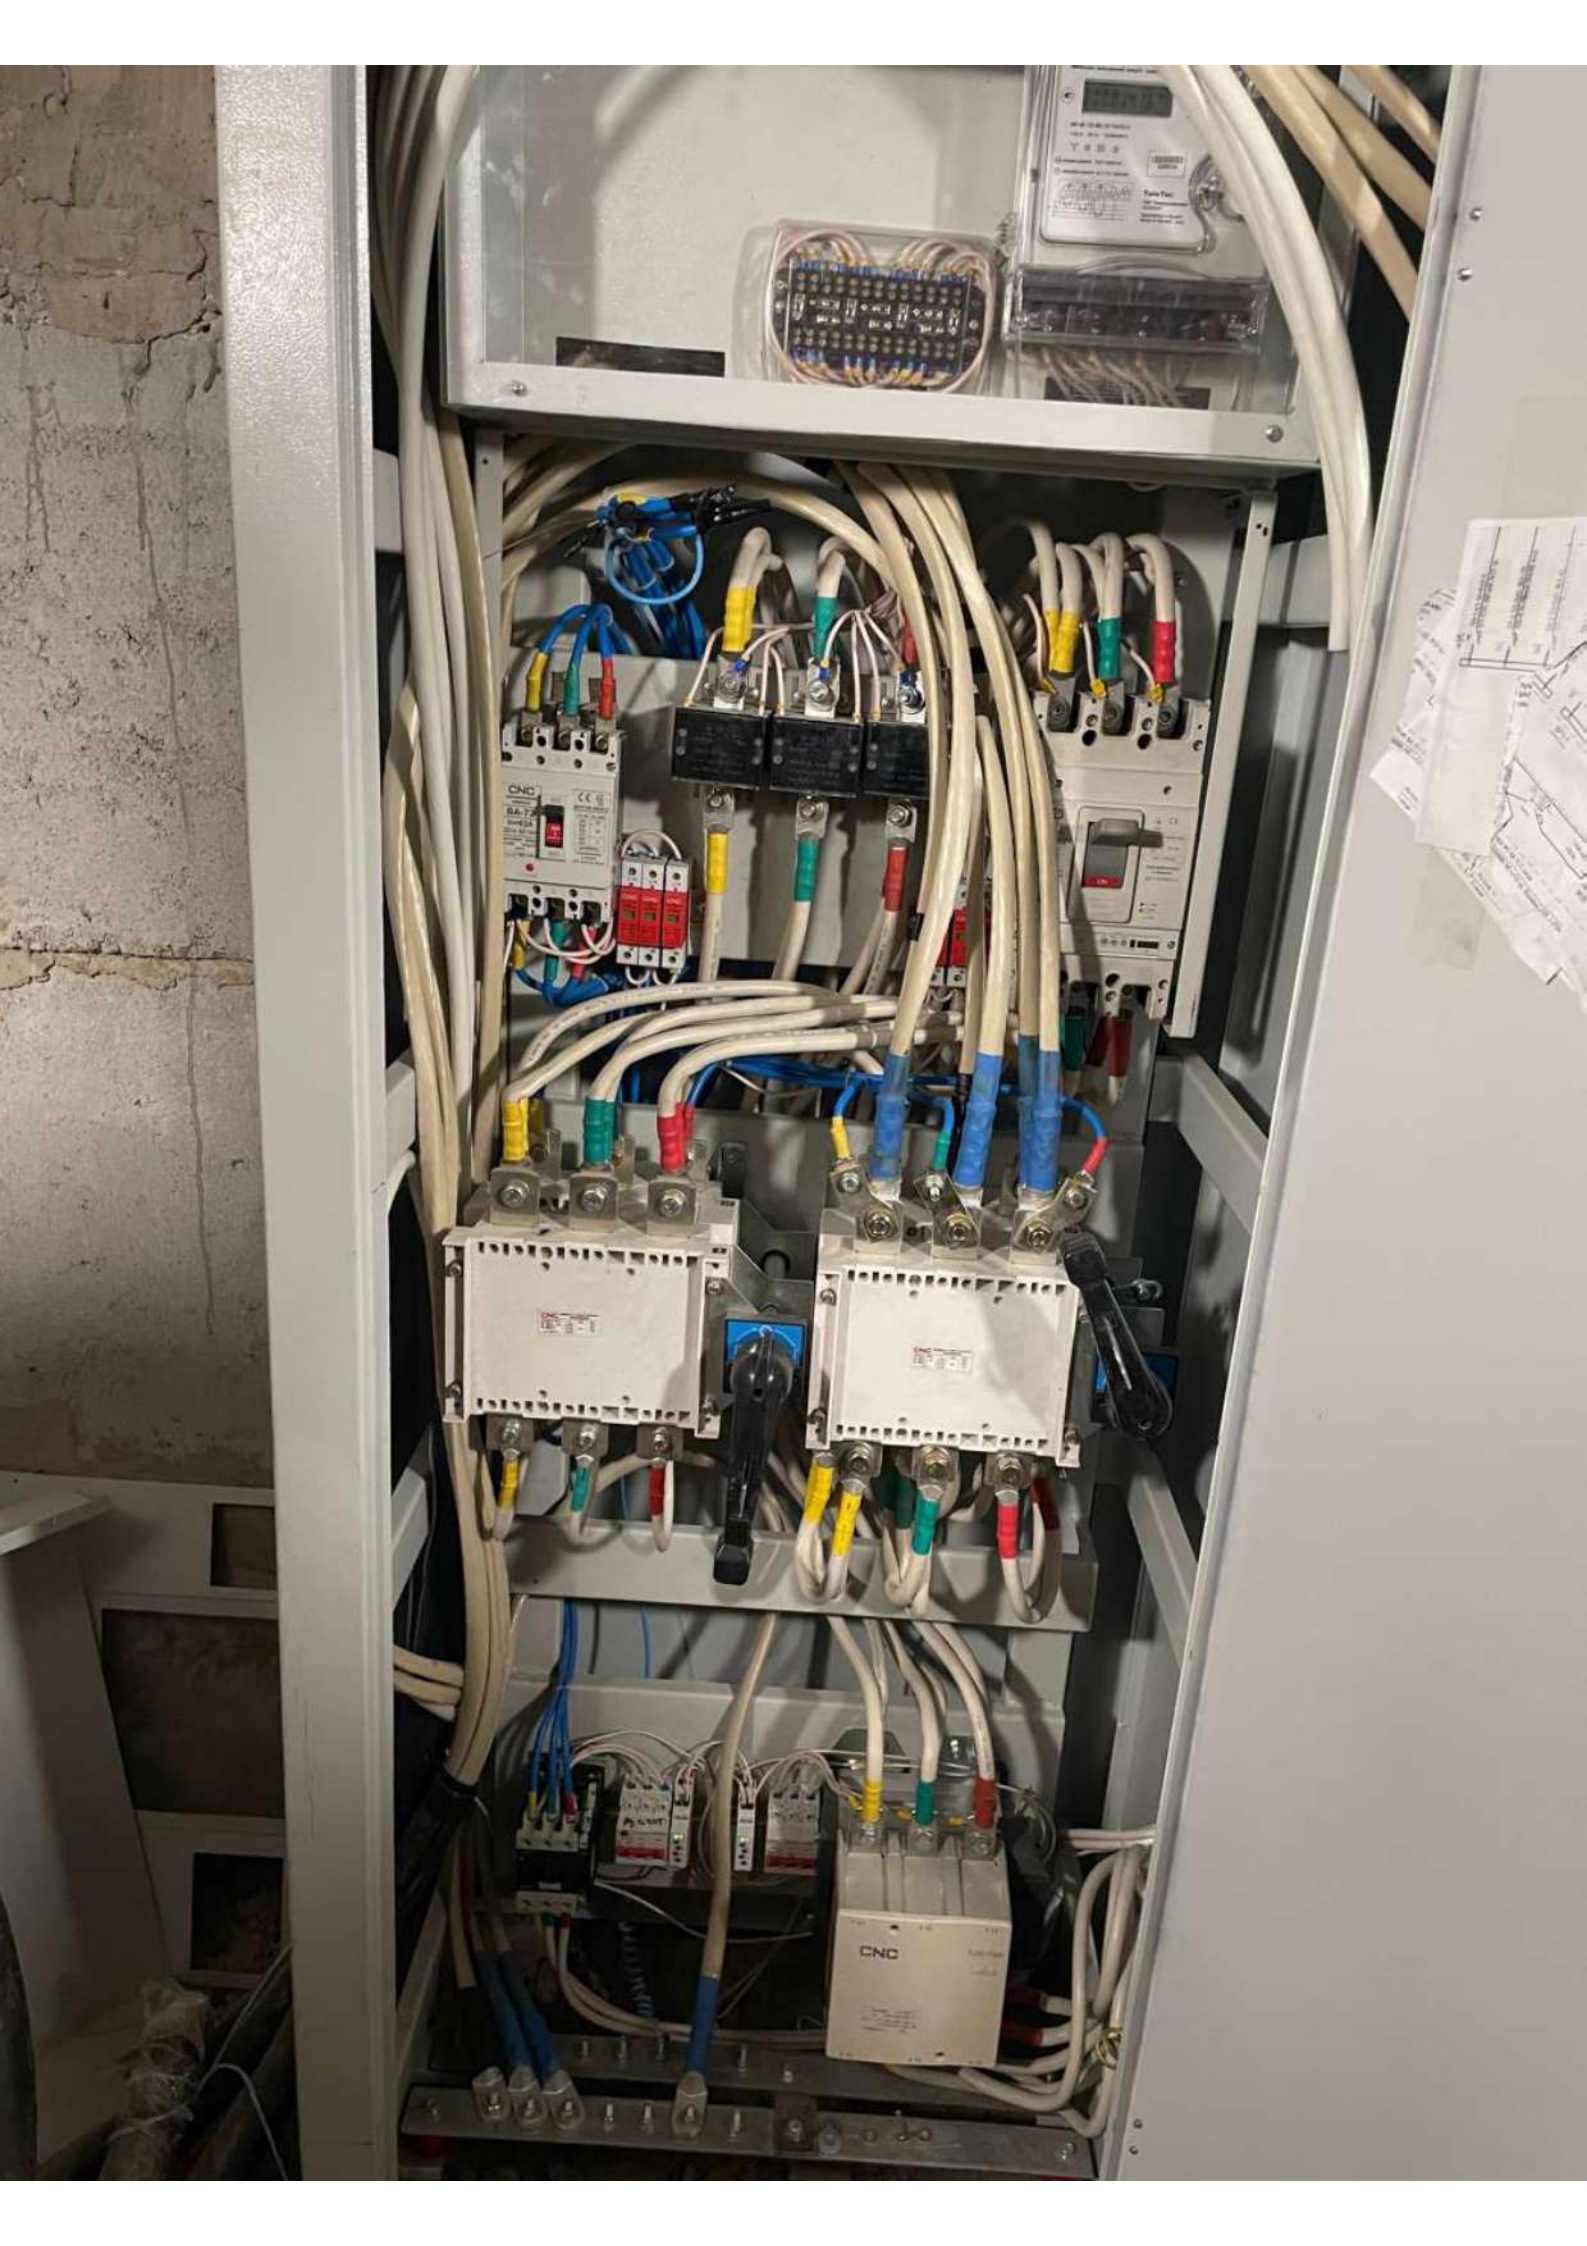

Лічильник електричної енергії трифазний

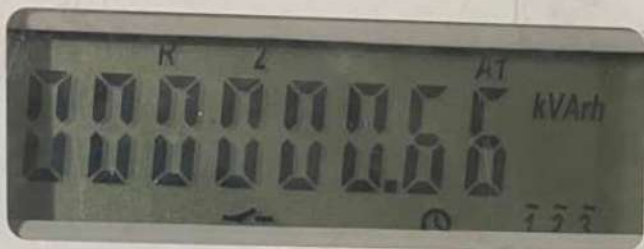


10000

10000 імр/(кВт·год)


NP-06 TD ME.3F.TхPD-U

5 (6) A 50 Гц 3x220/380 В



① активна енергія ГОСТ 30206-94

② реактивна енергія ДСТУ ГОСТ 26035-2008

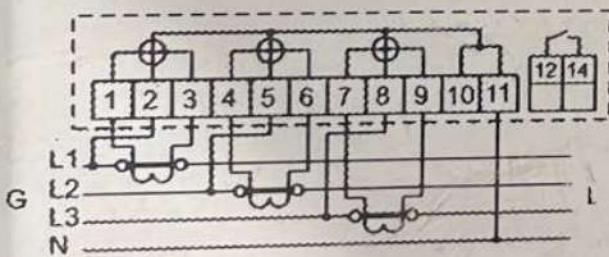

TeleTec

ТОВ "Телекомунікаційні технології"

Вироблено в Україні
Made in Ukraine 2012р





