



































































1
поверх







1
поверх


ЛІС
←





25 БЛОК А
ПОВЕРХ
A208 - A216



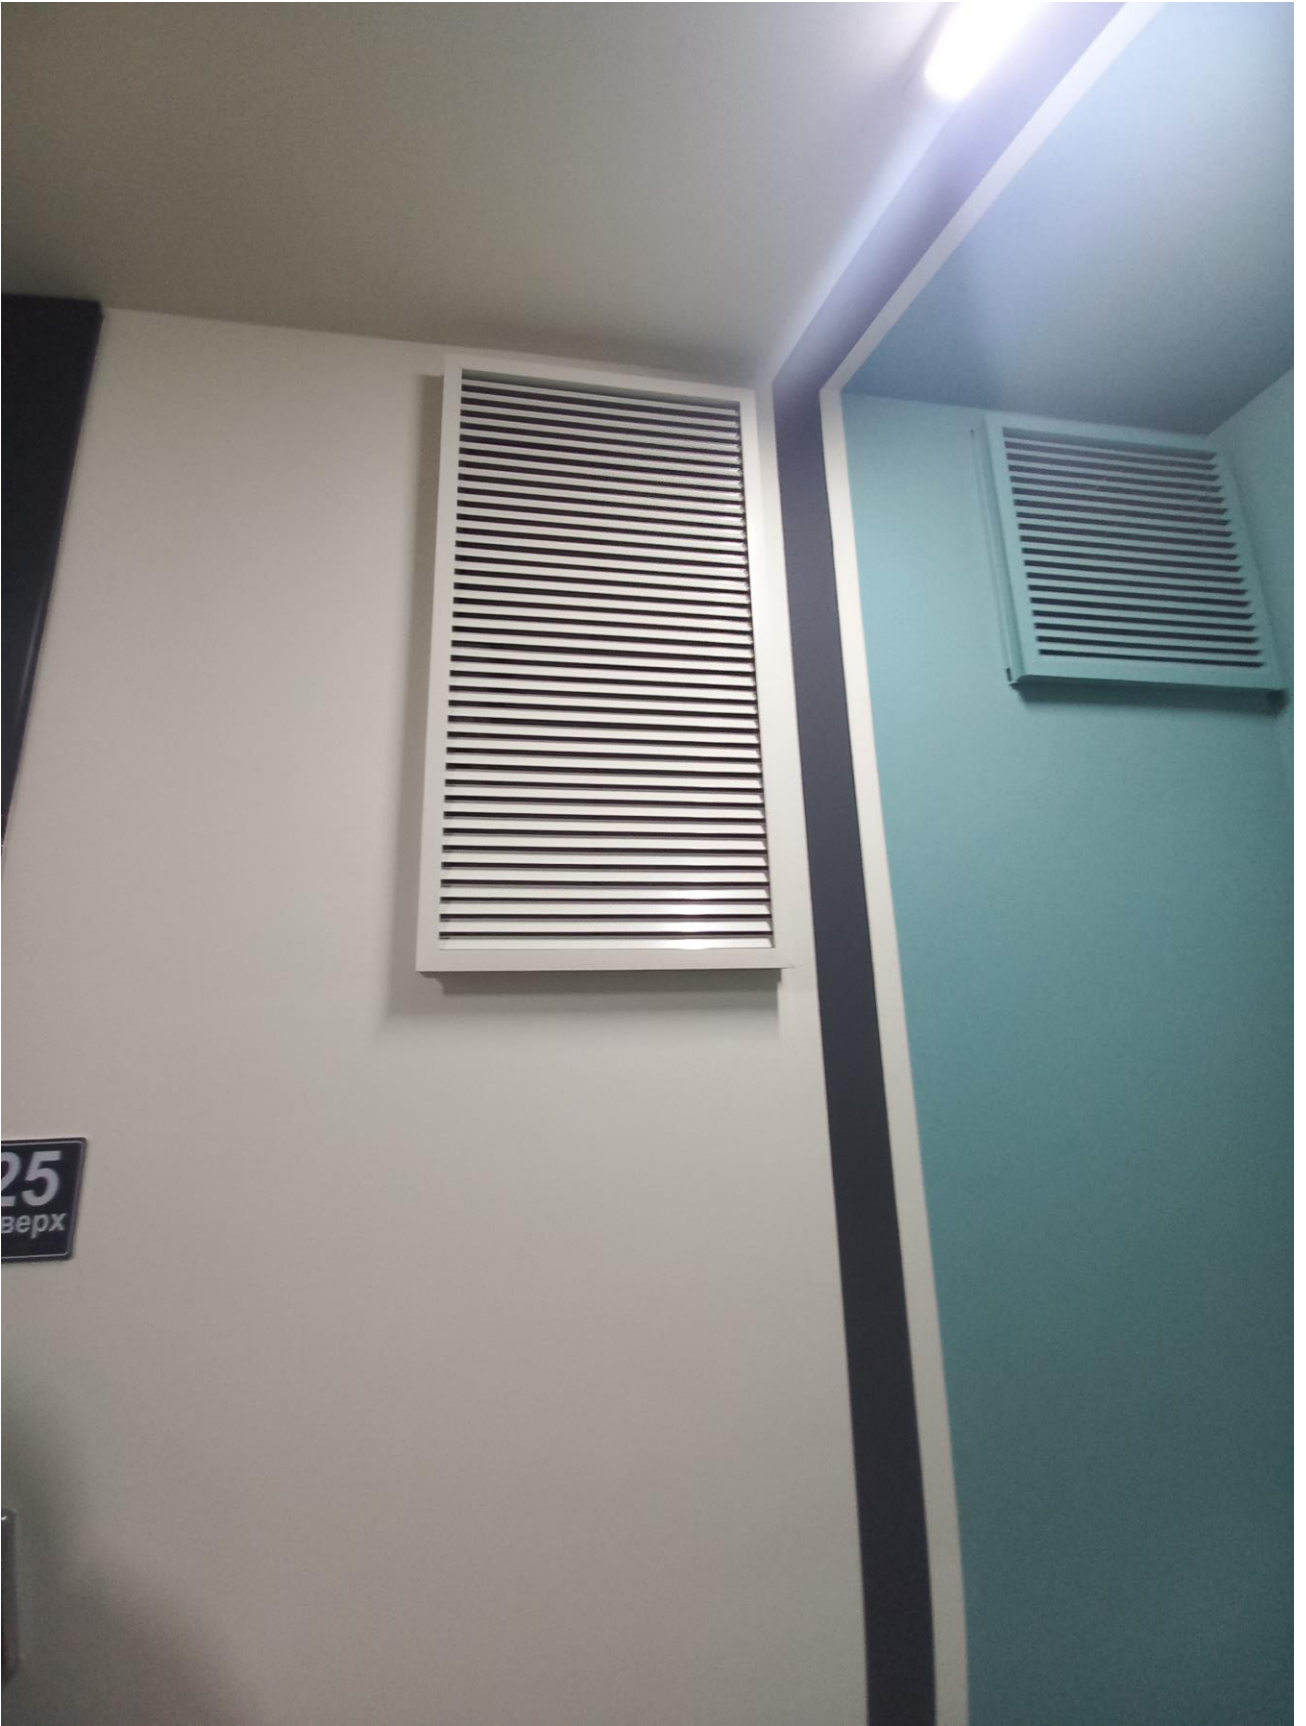
























































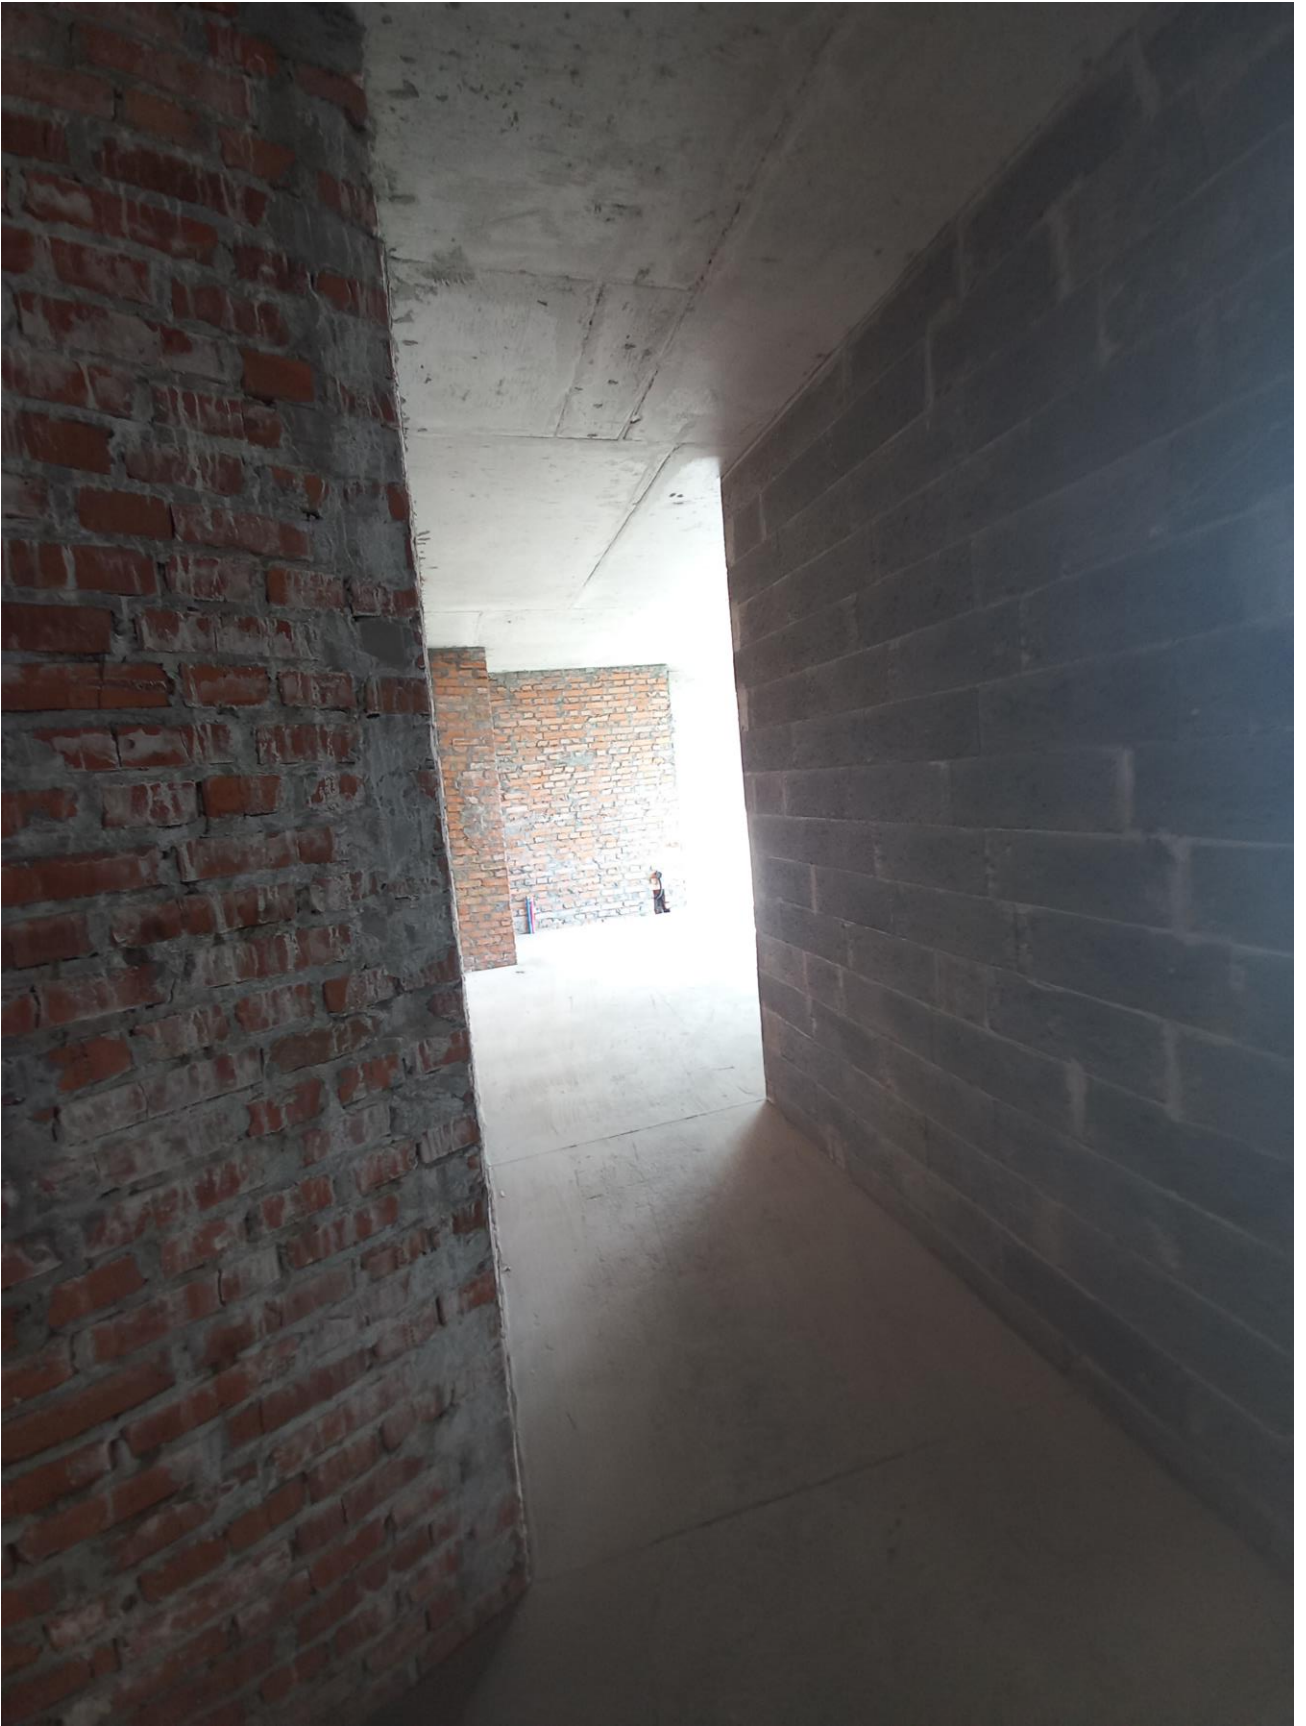

























ВИХІД
EXIT























Дата: 20.11.20
207/100
Партія
ОДС
ПРОМІСЛ


IP CONTROLLER
UCS222LVA OVFR03B
Supply voltage: 3 phase, 380V, 50Hz
Control circuit voltage:
AC voltage - 48 V
DC voltage - 30 V
Weight, max. kg:
Vintage:
Serial number:
Number:
Protection class - IP23
Climatic type - UKHL4
Otis Contract Logistik Center
Saint-Petersburg

OTIS
OTIS LIFT
Khimicheskiy peruloik, 14
Saint-Petersburg, RUSSIA
Type Examination
Certificate Number **NL16-400-1002-024-12**
UCMP
OTIS part N°
ZAA27602P
CE
0400
ZAA10278

15

БЛОК А
ПОВЕРХ

A118 - A126

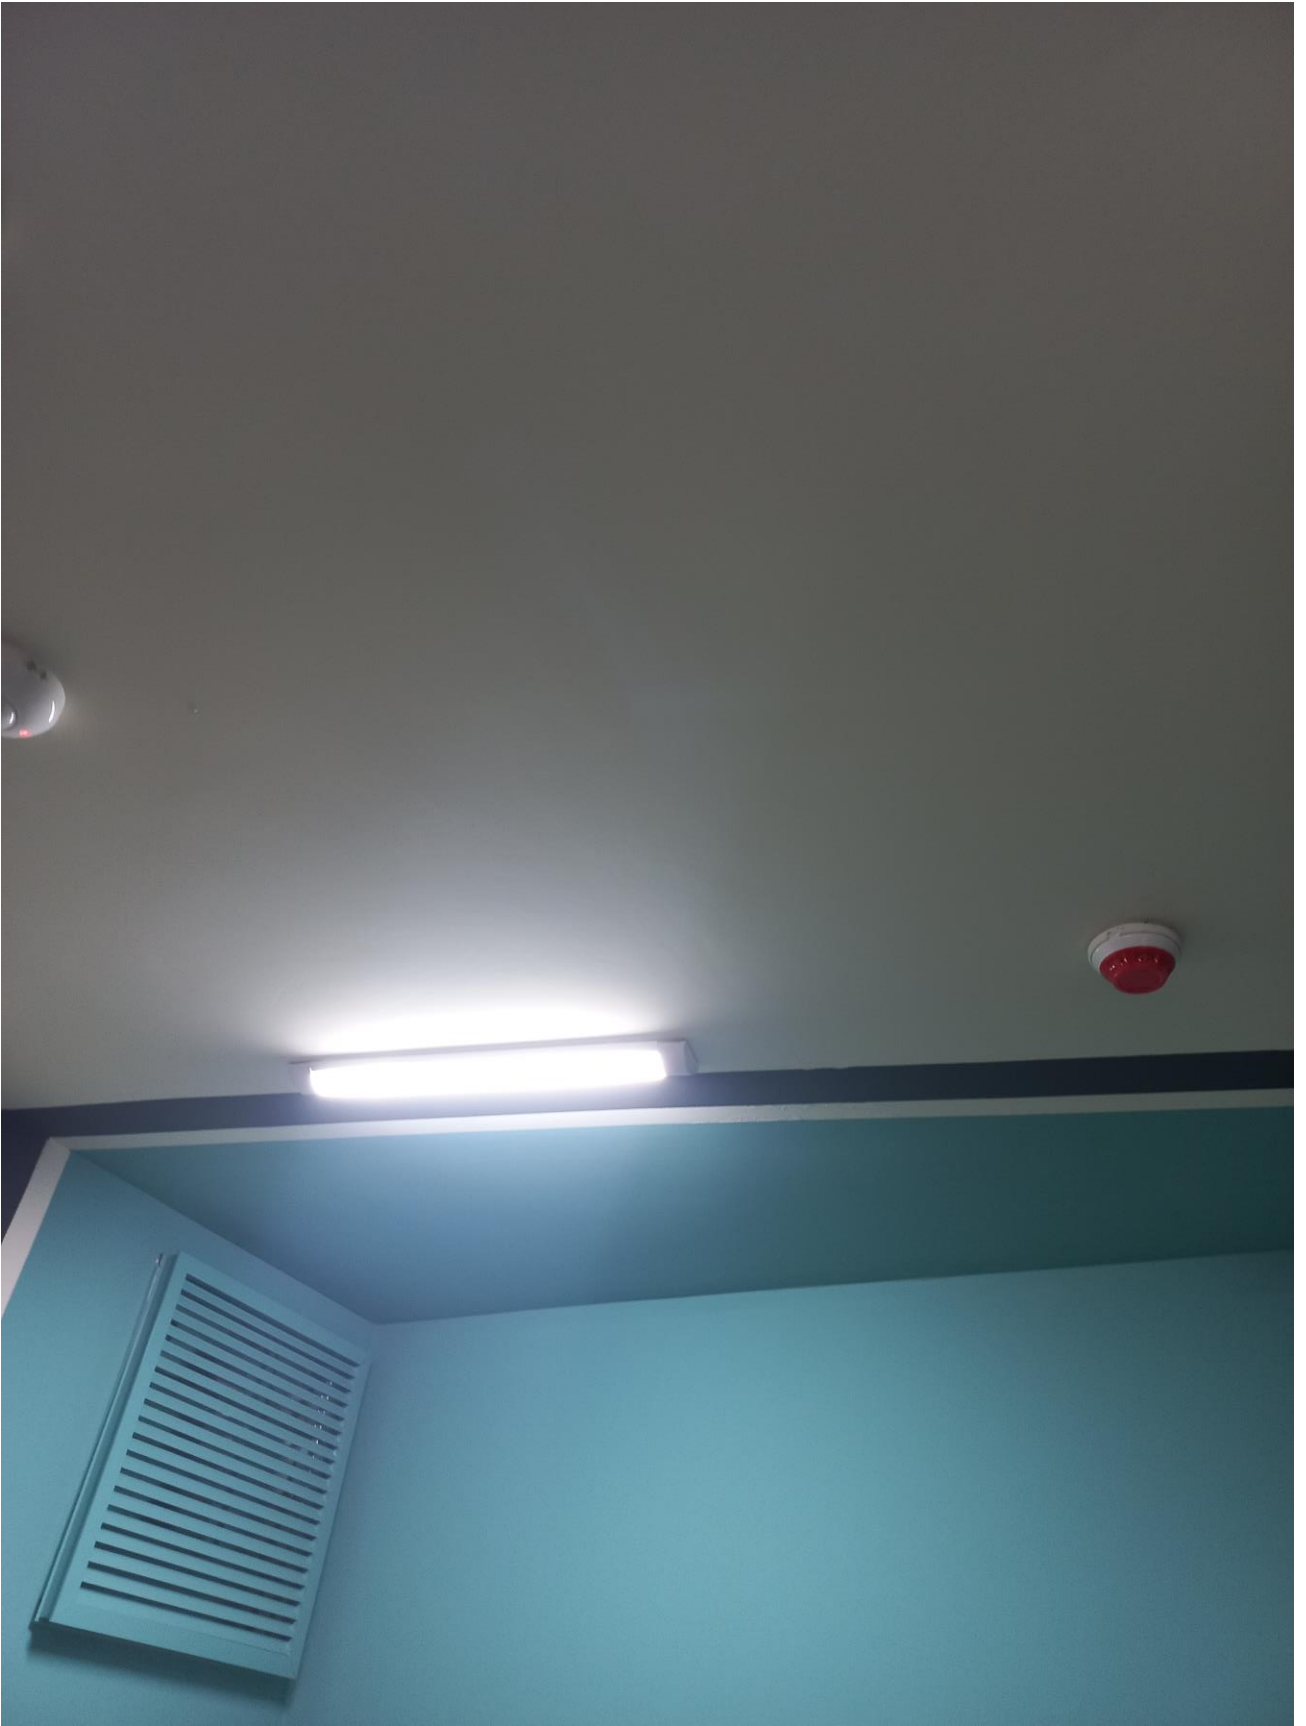













































2

БЛОК А
ПОВЕРХ


А1 - А9





Warning
High Voltage
Do Not Touch



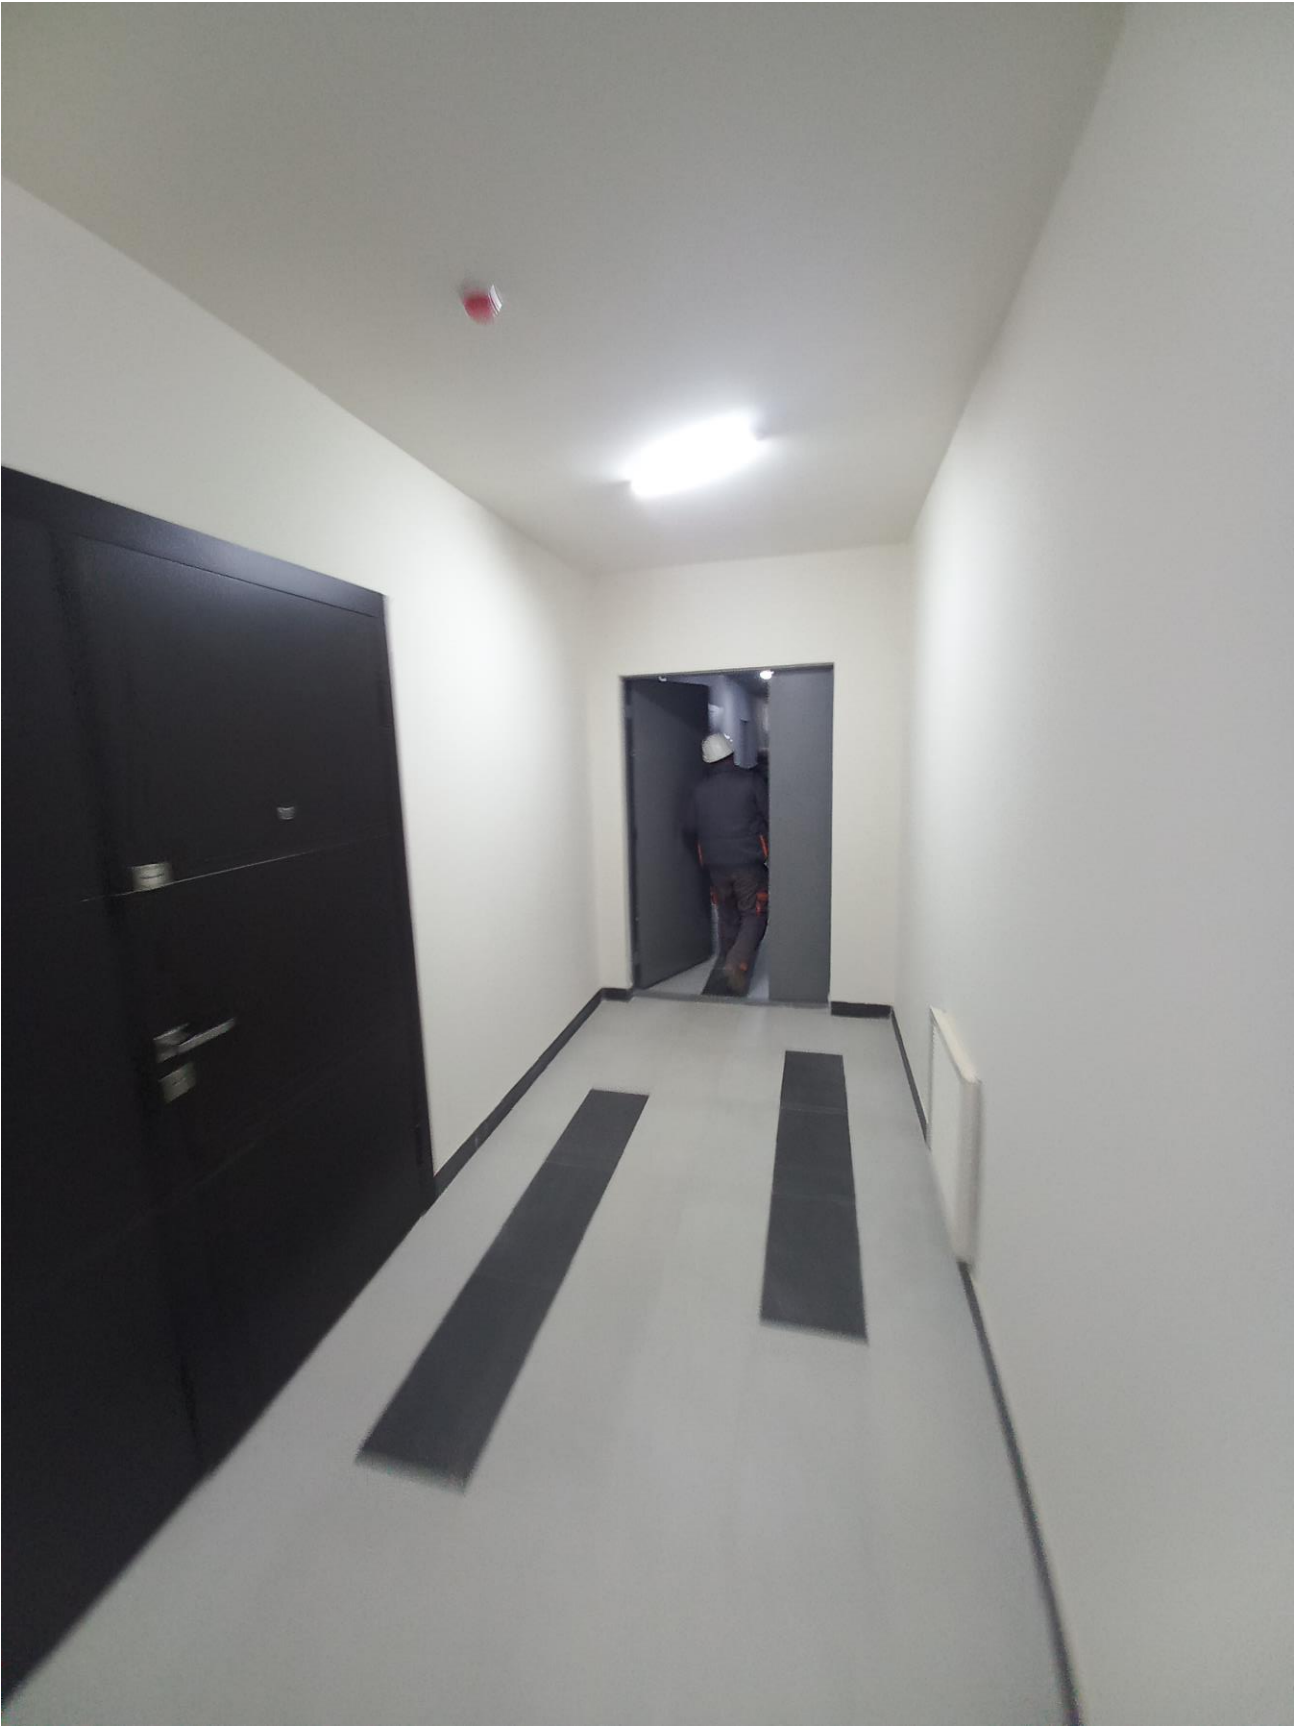





2

БЛОК
ПОВЕРХ

Б1 - Б8

2


БЛОК Б
ПОВЕРХ


51 - Б8







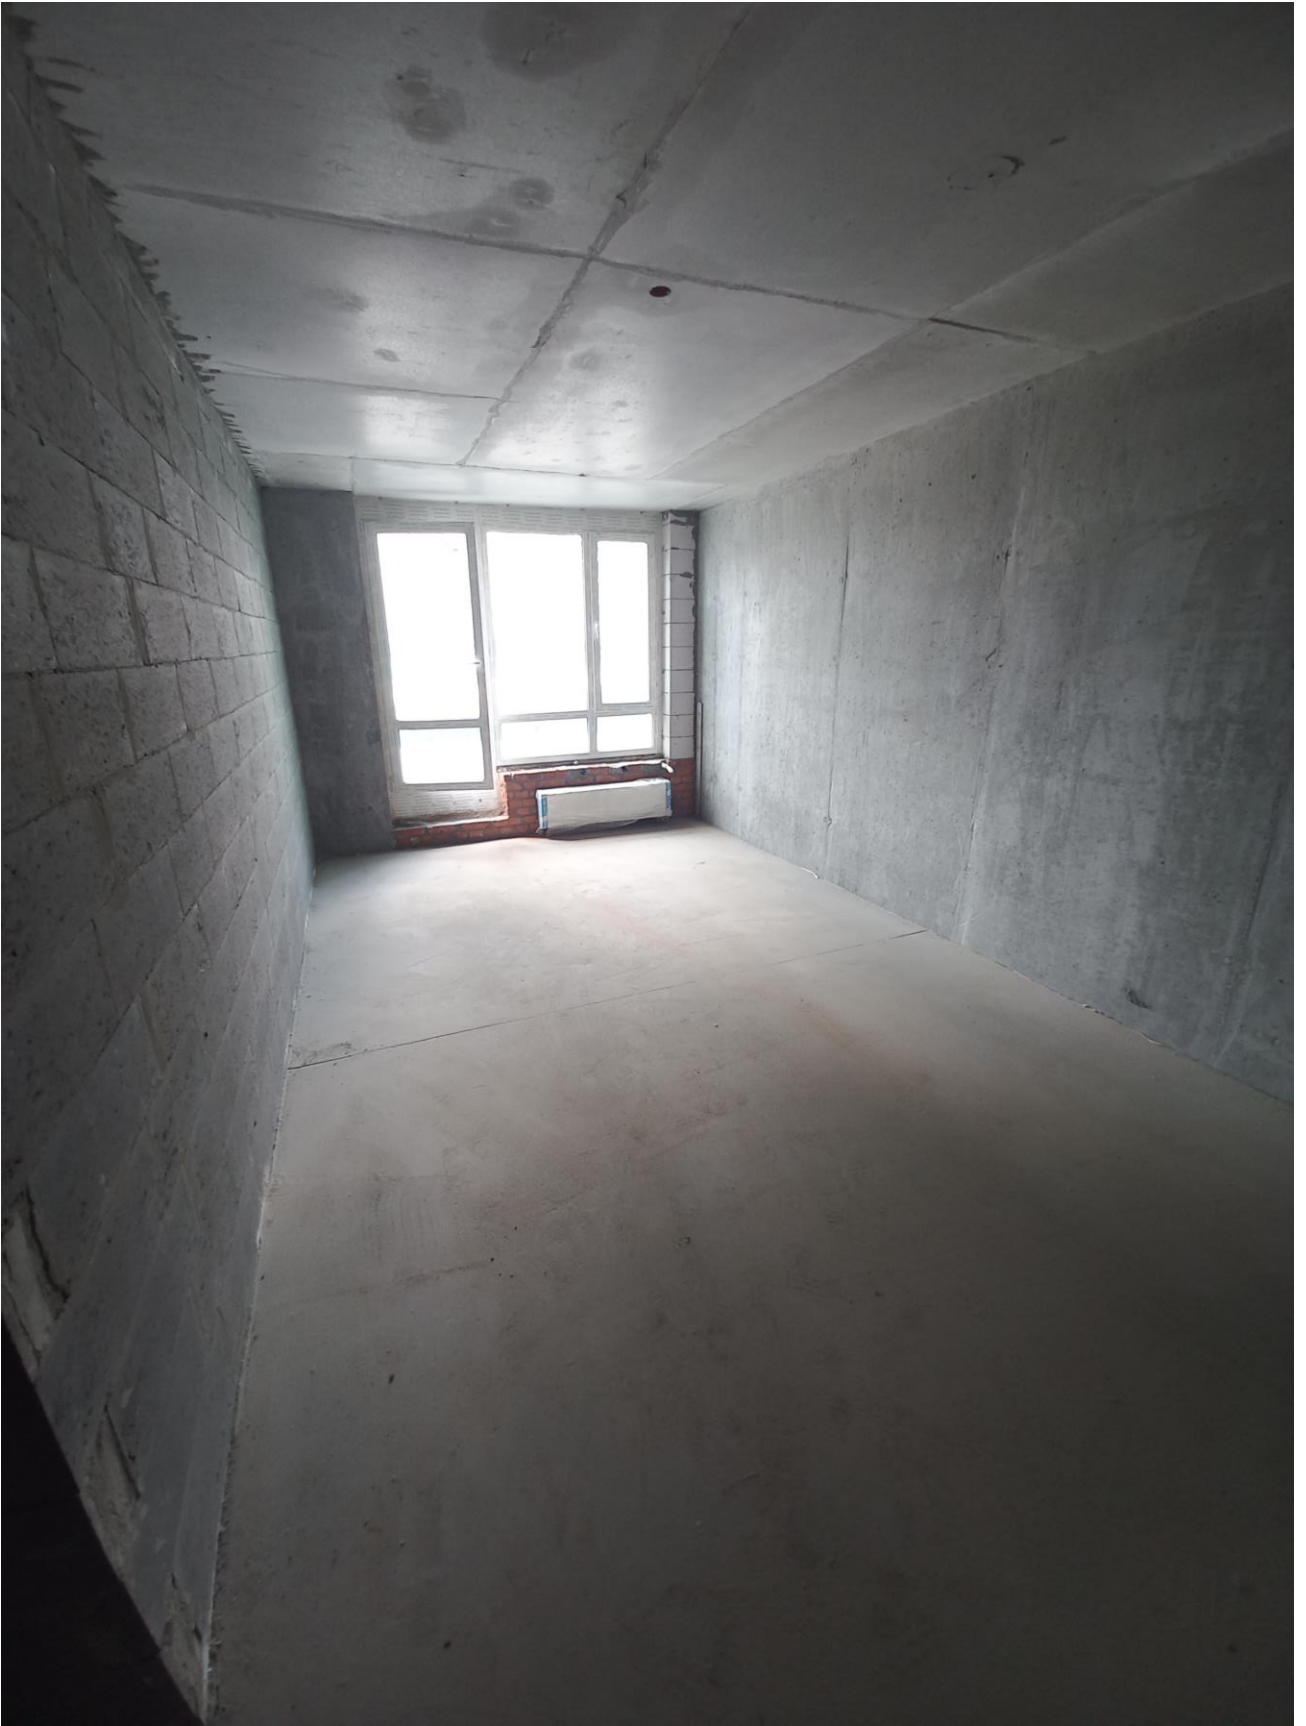

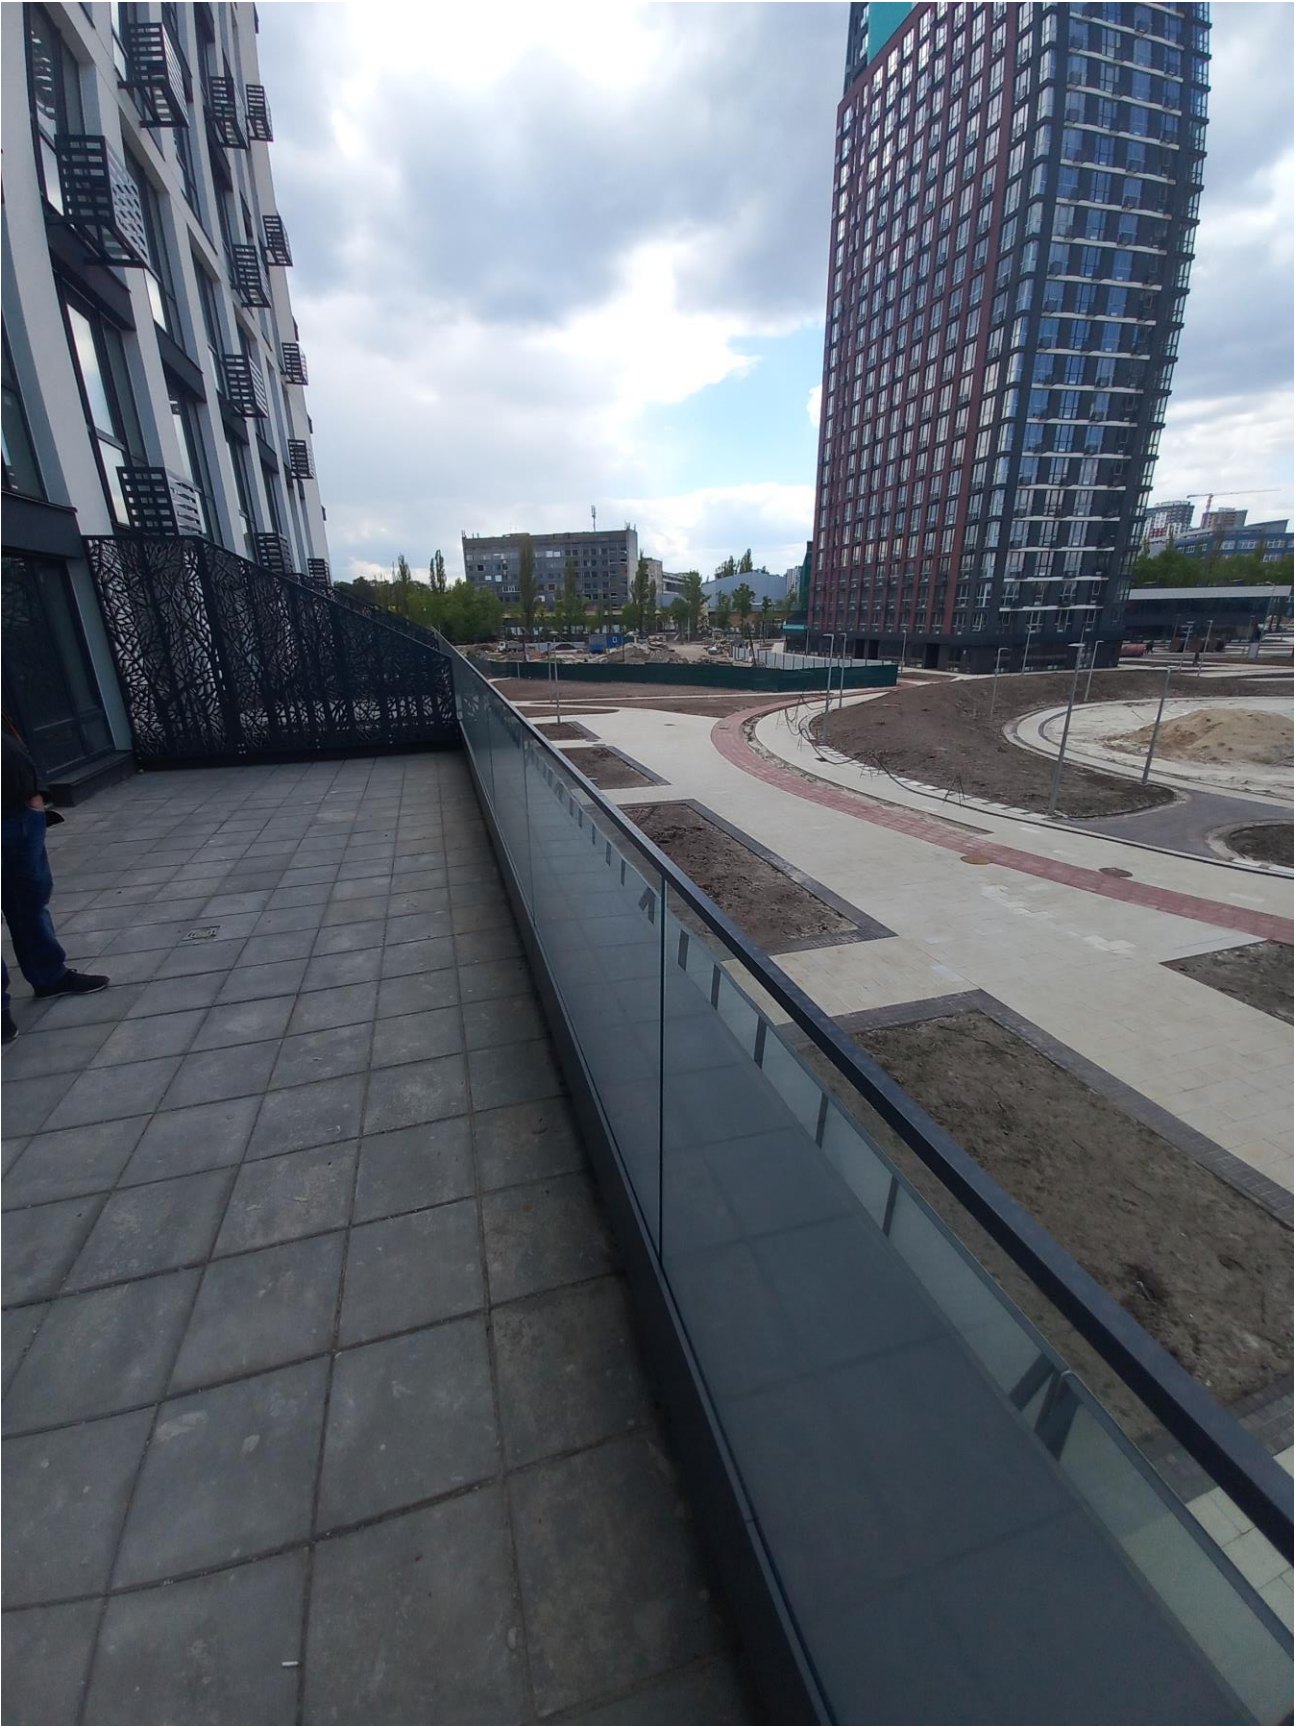

















1

Служба
Скорой
























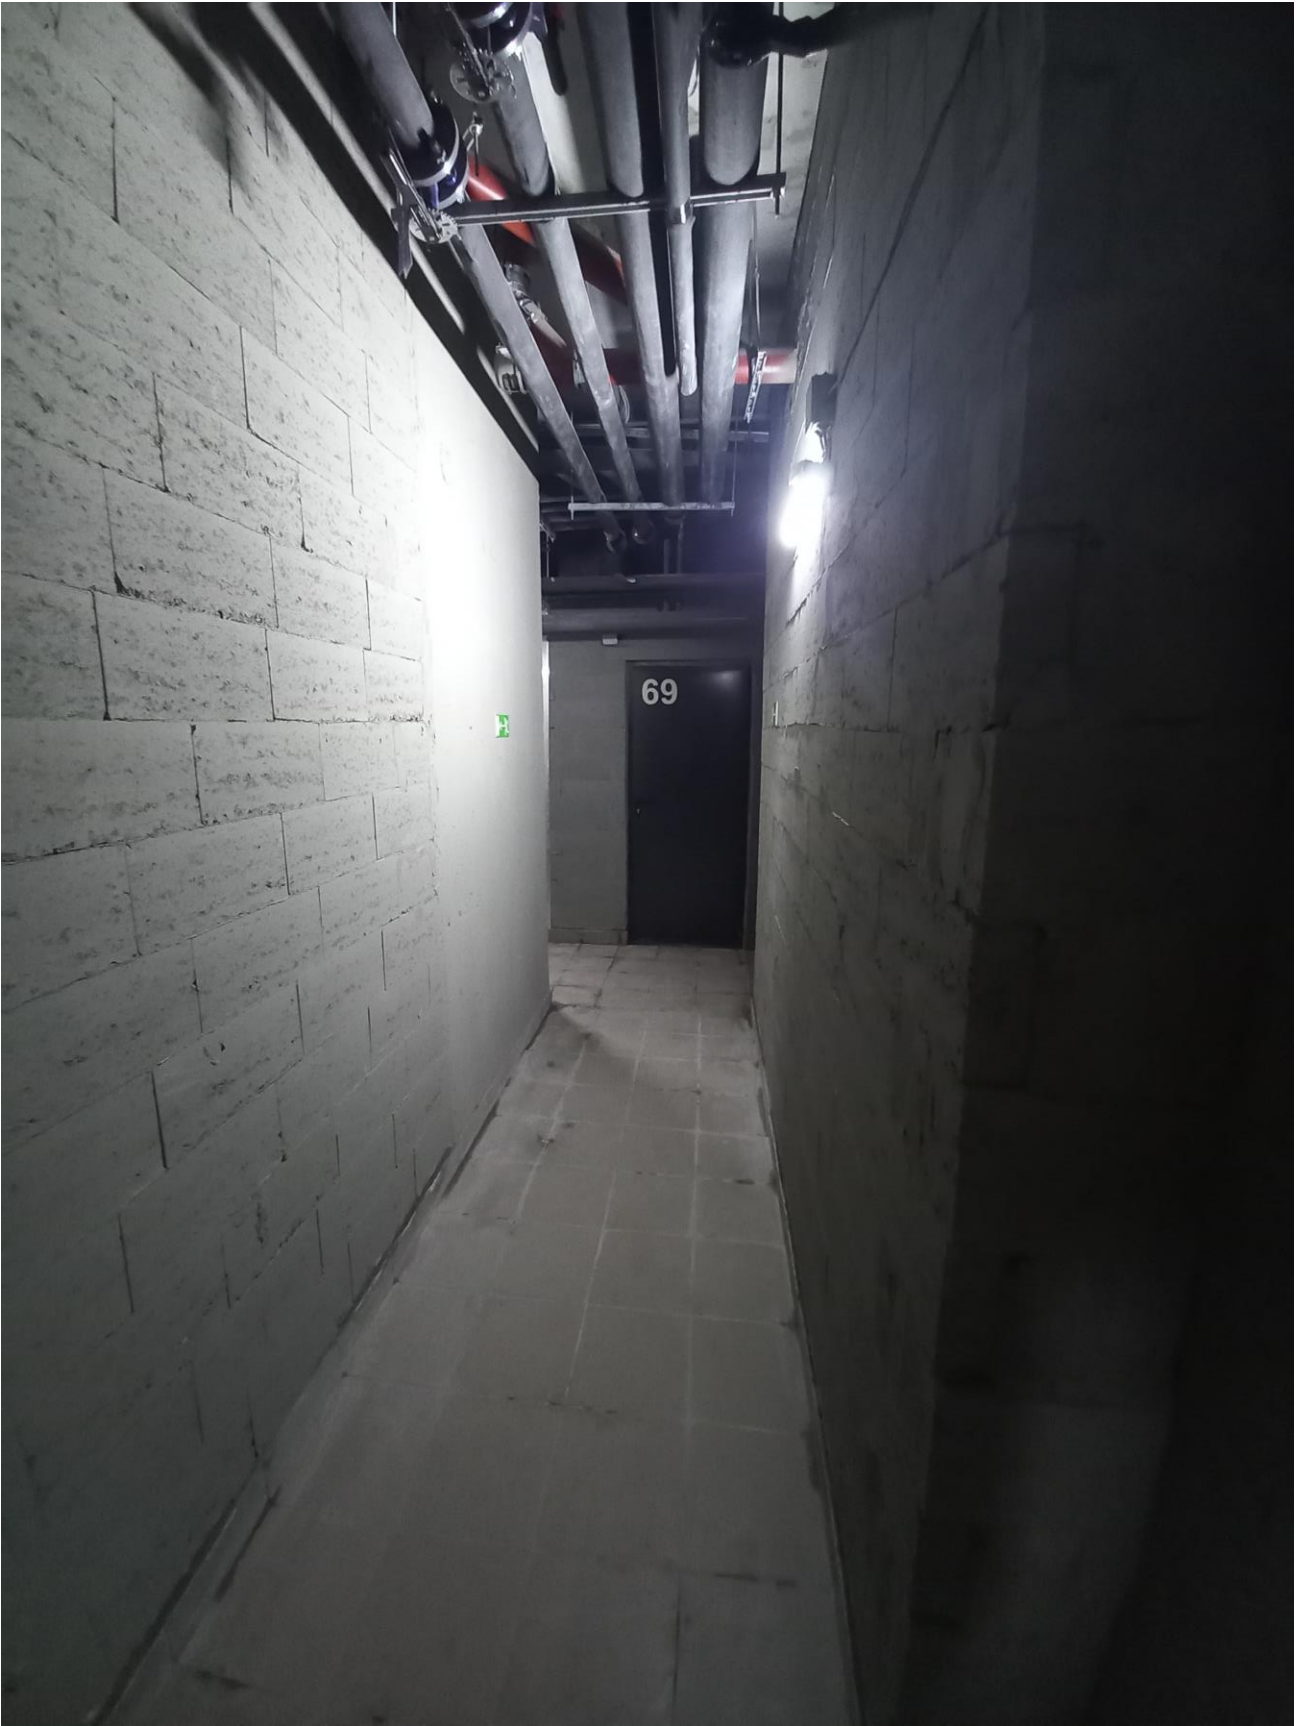








































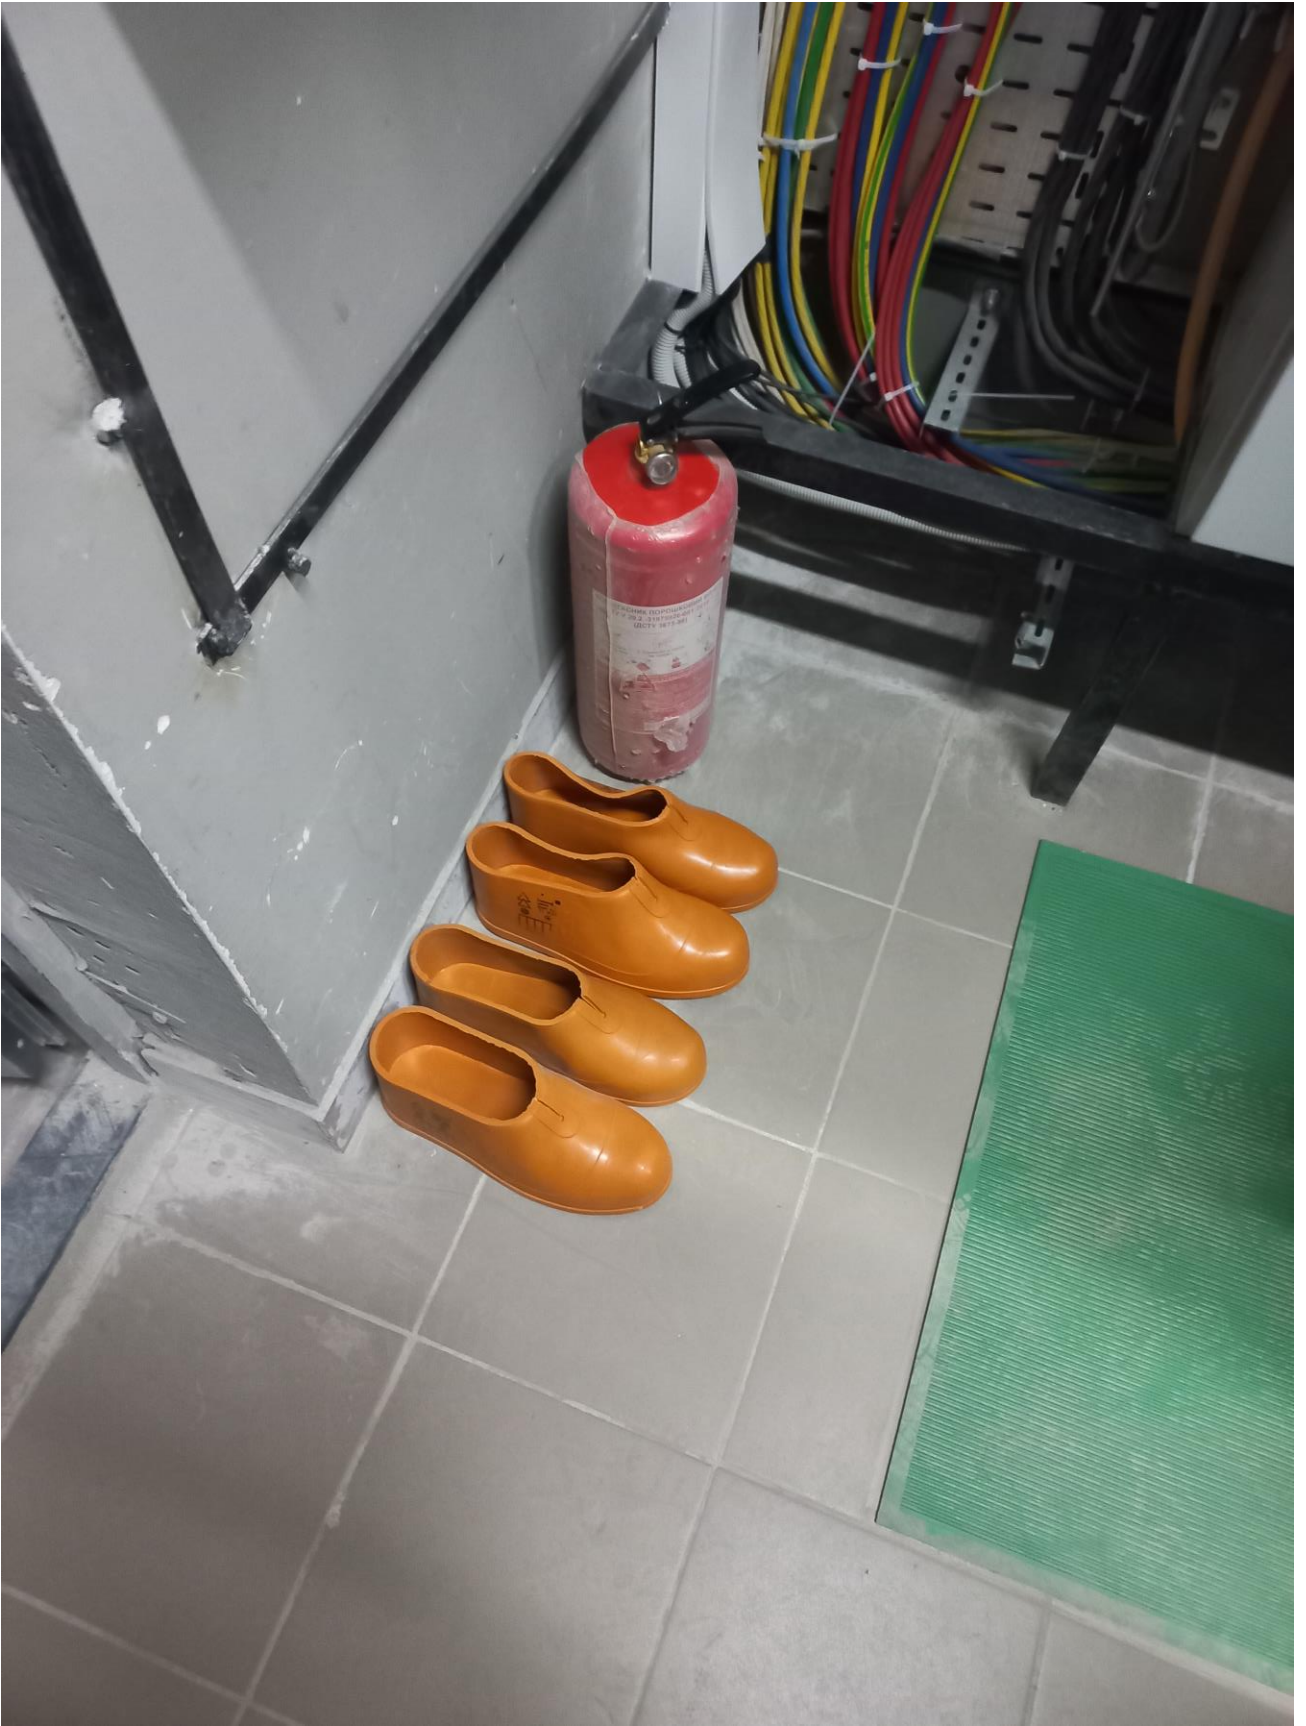







**ВОДОМІРНИЙ
ВУЗОЛ
В-1 (ВБУ)**

**ВОДОМІРНИЙ
ВУЗОЛ
В-10 (ПОЛІВ)**





**ВОДОМІРНИЙ
вузол ГЗП
II-ЗОНА**

**ВОДОМІРНИЙ
вузол ГЗП
I-ЗОНА**

