









































11  
1111









УБАГАЌ  
УЧЕЊА ЗАШТИТЕ КОМУНИКАЦИЈИ  
САВЕЊАЊА ИЛИ ПУЊА  
СИСТЕМА СЕРИЈА 104





**УВАГА!**  
ВСЕ ЗАПОВІДІТЬ ПРИЙШЕЮЧІ!  
АВАРИЙНИЙ ВИКІЛ ГАЗУ  
ВИКЛИЧТЕ СЛУЖБУ 104.



**ВХІД**









ЛПКИТ ГАММА-132

№	ИД	ИД	ИД	ИД	ИД
02	00000-002	02	00000-002	02	00000-002
03	00000-003	03	00000-003	03	00000-003
04	00000-004	04	00000-004	04	00000-004
05	00000-005	05	00000-005	05	00000-005
06	00000-006	06	00000-006	06	00000-006
07	00000-007	07	00000-007	07	00000-007
08	00000-008	08	00000-008	08	00000-008
09	00000-009	09	00000-009	09	00000-009
10	00000-010	10	00000-010	10	00000-010
11	00000-011	11	00000-011	11	00000-011
12	00000-012	12	00000-012	12	00000-012
13	00000-013	13	00000-013	13	00000-013
14	00000-014	14	00000-014	14	00000-014
15	00000-015	15	00000-015	15	00000-015
16	00000-016	16	00000-016	16	00000-016
17	00000-017	17	00000-017	17	00000-017
18	00000-018	18	00000-018	18	00000-018
19	00000-019	19	00000-019	19	00000-019
20	00000-020	20	00000-020	20	00000-020

ЛПКИТ ГАММА-132



БЛОК РЕЛЕ АДРЕСНЫЙ ГАММА-8/8

№	ИД	ИД	ИД	ИД	ИД
01	00000-001	01	00000-001	01	00000-001
02	00000-002	02	00000-002	02	00000-002
03	00000-003	03	00000-003	03	00000-003
04	00000-004	04	00000-004	04	00000-004
05	00000-005	05	00000-005	05	00000-005
06	00000-006	06	00000-006	06	00000-006
07	00000-007	07	00000-007	07	00000-007
08	00000-008	08	00000-008	08	00000-008




















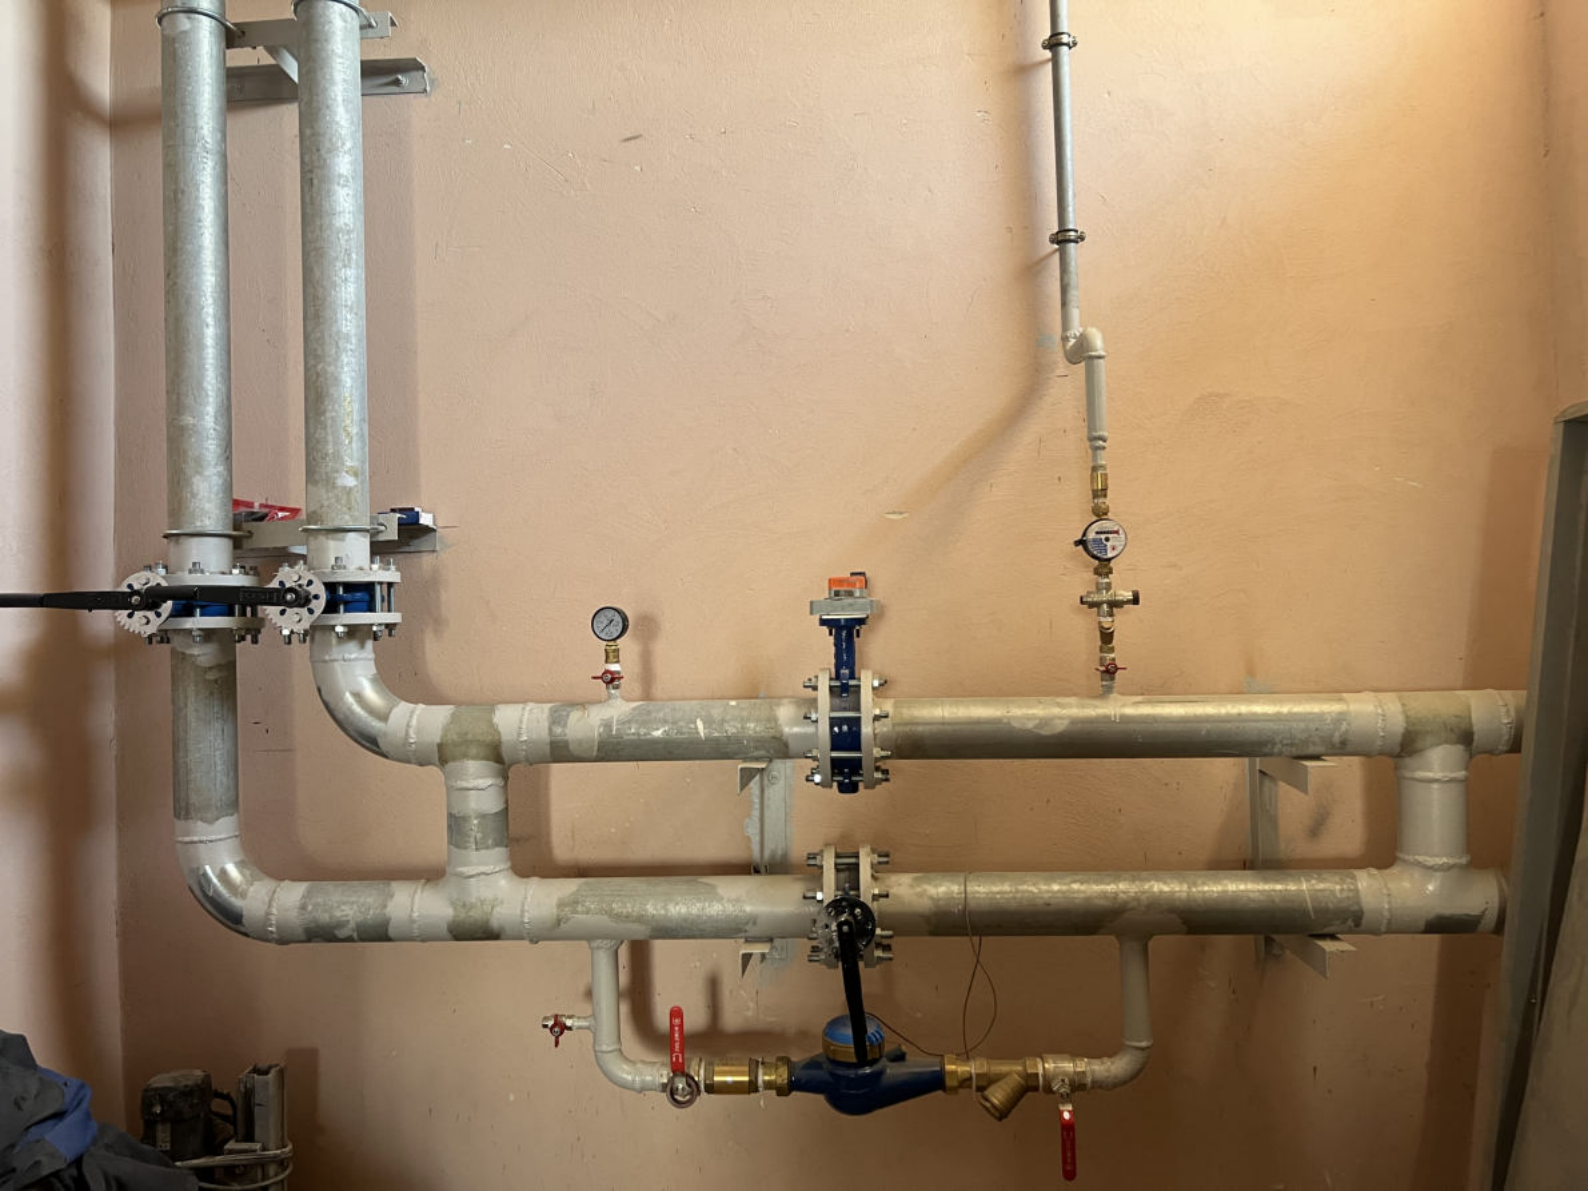



GIDROTEK  
00688404 m  
E-T 1.8-U  
Q<sub>max</sub> 2 m<sup>3</sup>/h  
1.6x3 D6.00  
V-MAD MAP 16  
3.0 / p63  
2021  
M21 001  
U.A. TR 001 23 F.16  
Garantissimo e Popolare  
0.850



680010089  
20202010089


M2  
MTK-UA  
0.16 m³/h  
MAD 16  
T50  
m³

Moran







GAMA 300 Mod. G2V 144  
20220825  
iEK  
3 x 230 V 400 V  
8 1000 A 50 Hz  
CE 1 20217 EN 62053-21  
CE 2 20217 EN 62053-22

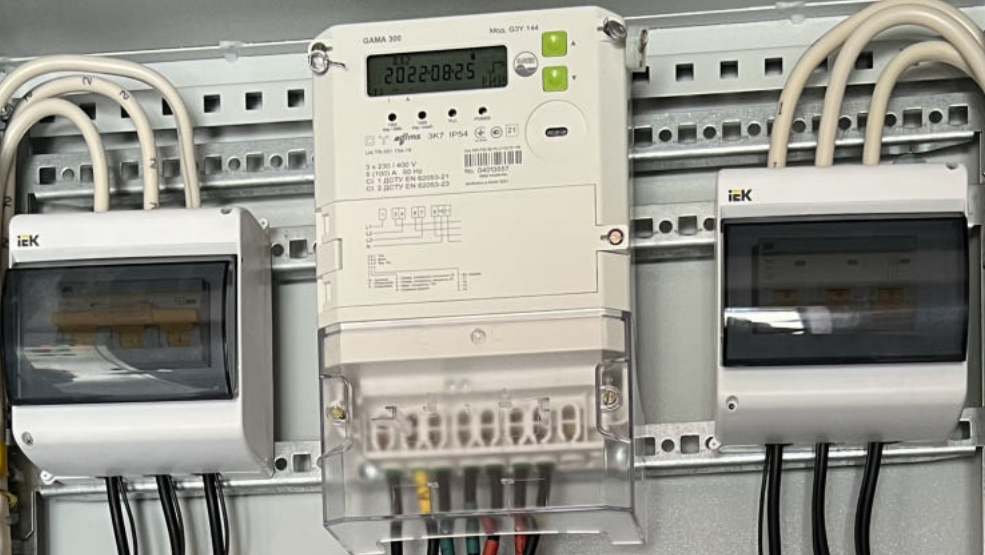

Terminal block with yellow and black connections, including a circular component labeled ERE.

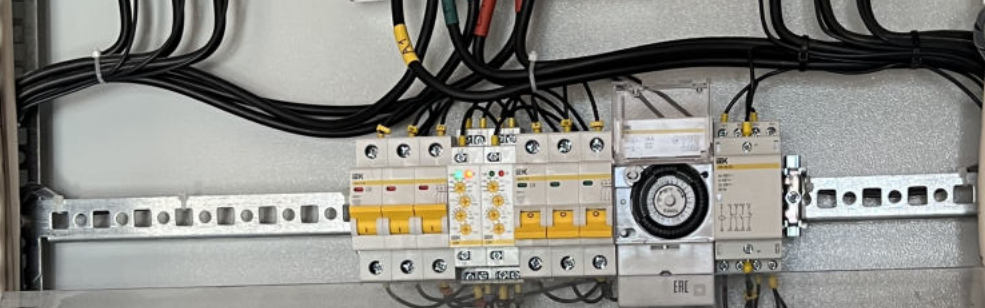

Large terminal block assembly with a prominent yellow lightning bolt warning symbol.

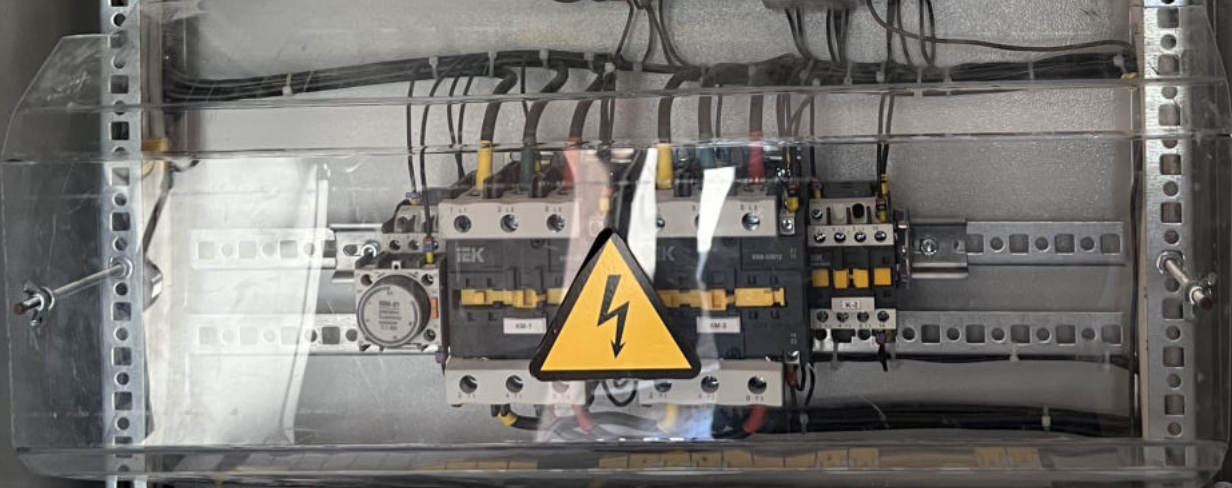

040	053	044	055	052
<i>Handwritten notes</i>	<i>Handwritten notes</i>	<i>Handwritten notes</i>	<i>Handwritten notes</i>	<i>Handwritten notes</i>

Bottom section of the rack containing a patch panel with orange and blue cables, and a terminal block with a label 'C-100'.























8




9



10



11

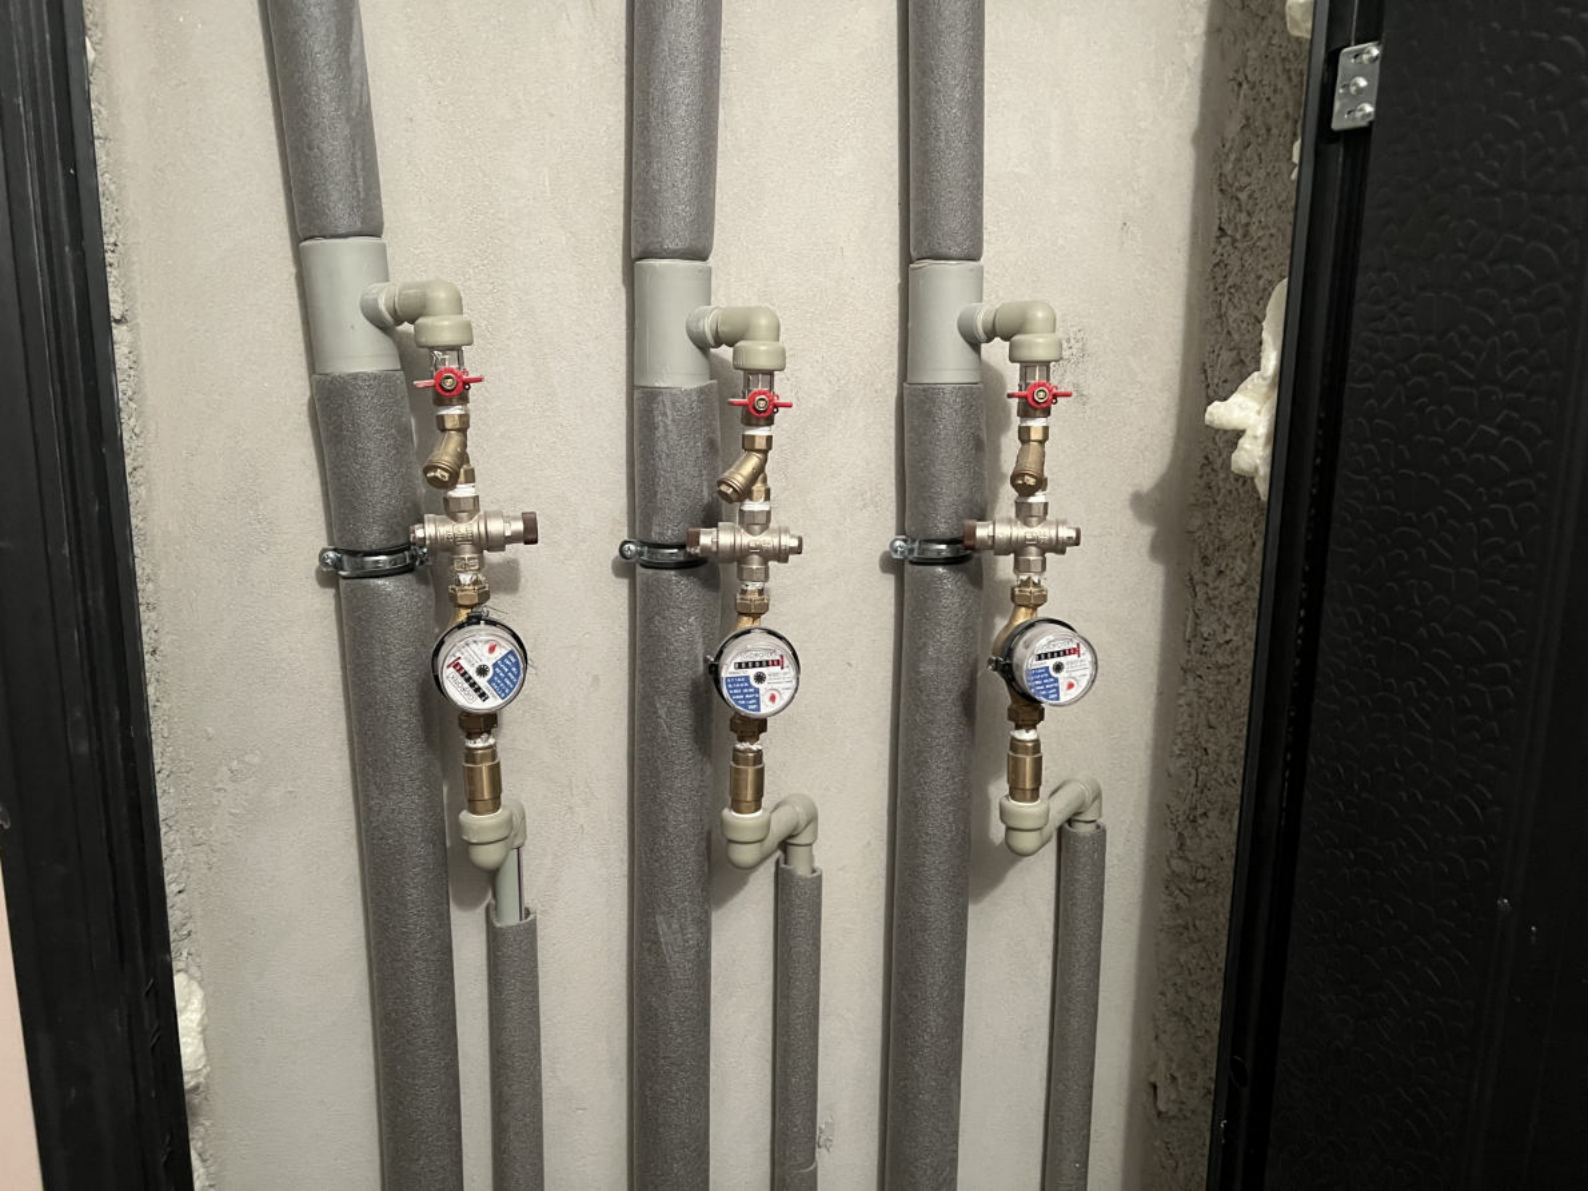

ПОЖЕЖА





12



13



14



























3







22



23



24



25

























BPT-2



K-FILM

K-FILM

K-FILM

K-FILM

K-FILM

K-FILM

PER-FILM

PER-FILM

PER-FILM

PER-FILM

PER-FILM



10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27



83



84



85



86



ЗАПУСК ПОЖАРНОЙ НАСОСЫ  
ПУСК СИСТЕМЫ ДИСКВАДЕНТИЯ



ЗАПУСК ПОЖЕЖНИХ НАСОСІВ  
ПУСК СИСТЕМИ ДИМОВИДАЛЕННЯ









ПОЖЕЖА





ЗАПУСК ПОЖАРНОЙ НАСОСЫ  
ПУСК СИСТЕМЫ ДИСКВАДЕНТИЯ















47



48



49





































**УБАҒА!**  
БҒИМ ДАМУГАТҚА ҚАРАМАСТАН  
АВАРИЯҒА БАПТА ҒАНА  
ЕРМӨШПЕ СӘБИҒИ ТӨД.











1	2	3
4	5	6
7	8	9
10	11	12
13	14	15
16	17	18
19	20	21

Red illuminated character: 16 (Braille character for 'a')

Yellow illuminated character: 17 (Braille character for 'b')

Red illuminated character: 21 (Braille character for 'z')

Nitto

PER-FILM

PER-FILM

PER-FILM

PER-FILM











71



72



73



74











































139



140



141



142













ЗАПУСК ПОЖЕЖНИХ НАСОСІВ

ПУСК СИСТЕМИ ДИМОВИДАЛЕННЯ

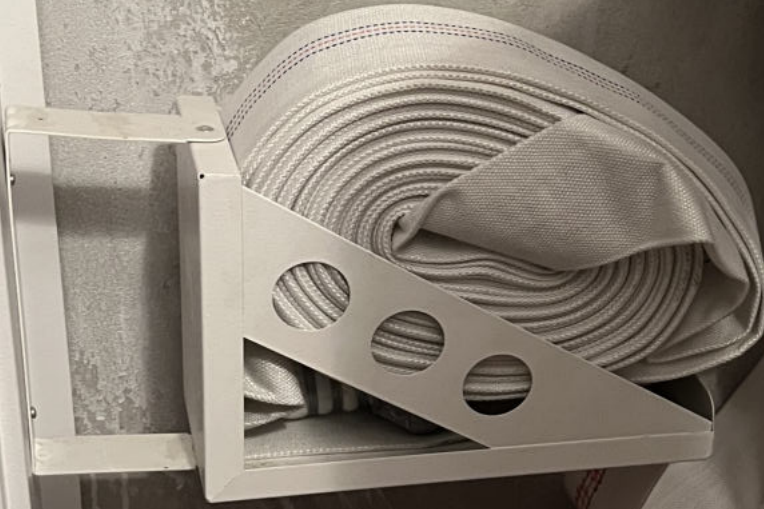

-1

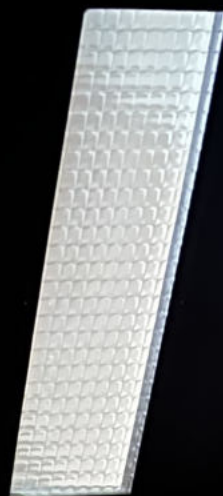





Small yellow sign above the window.





