


















344-356 ← → 357-358









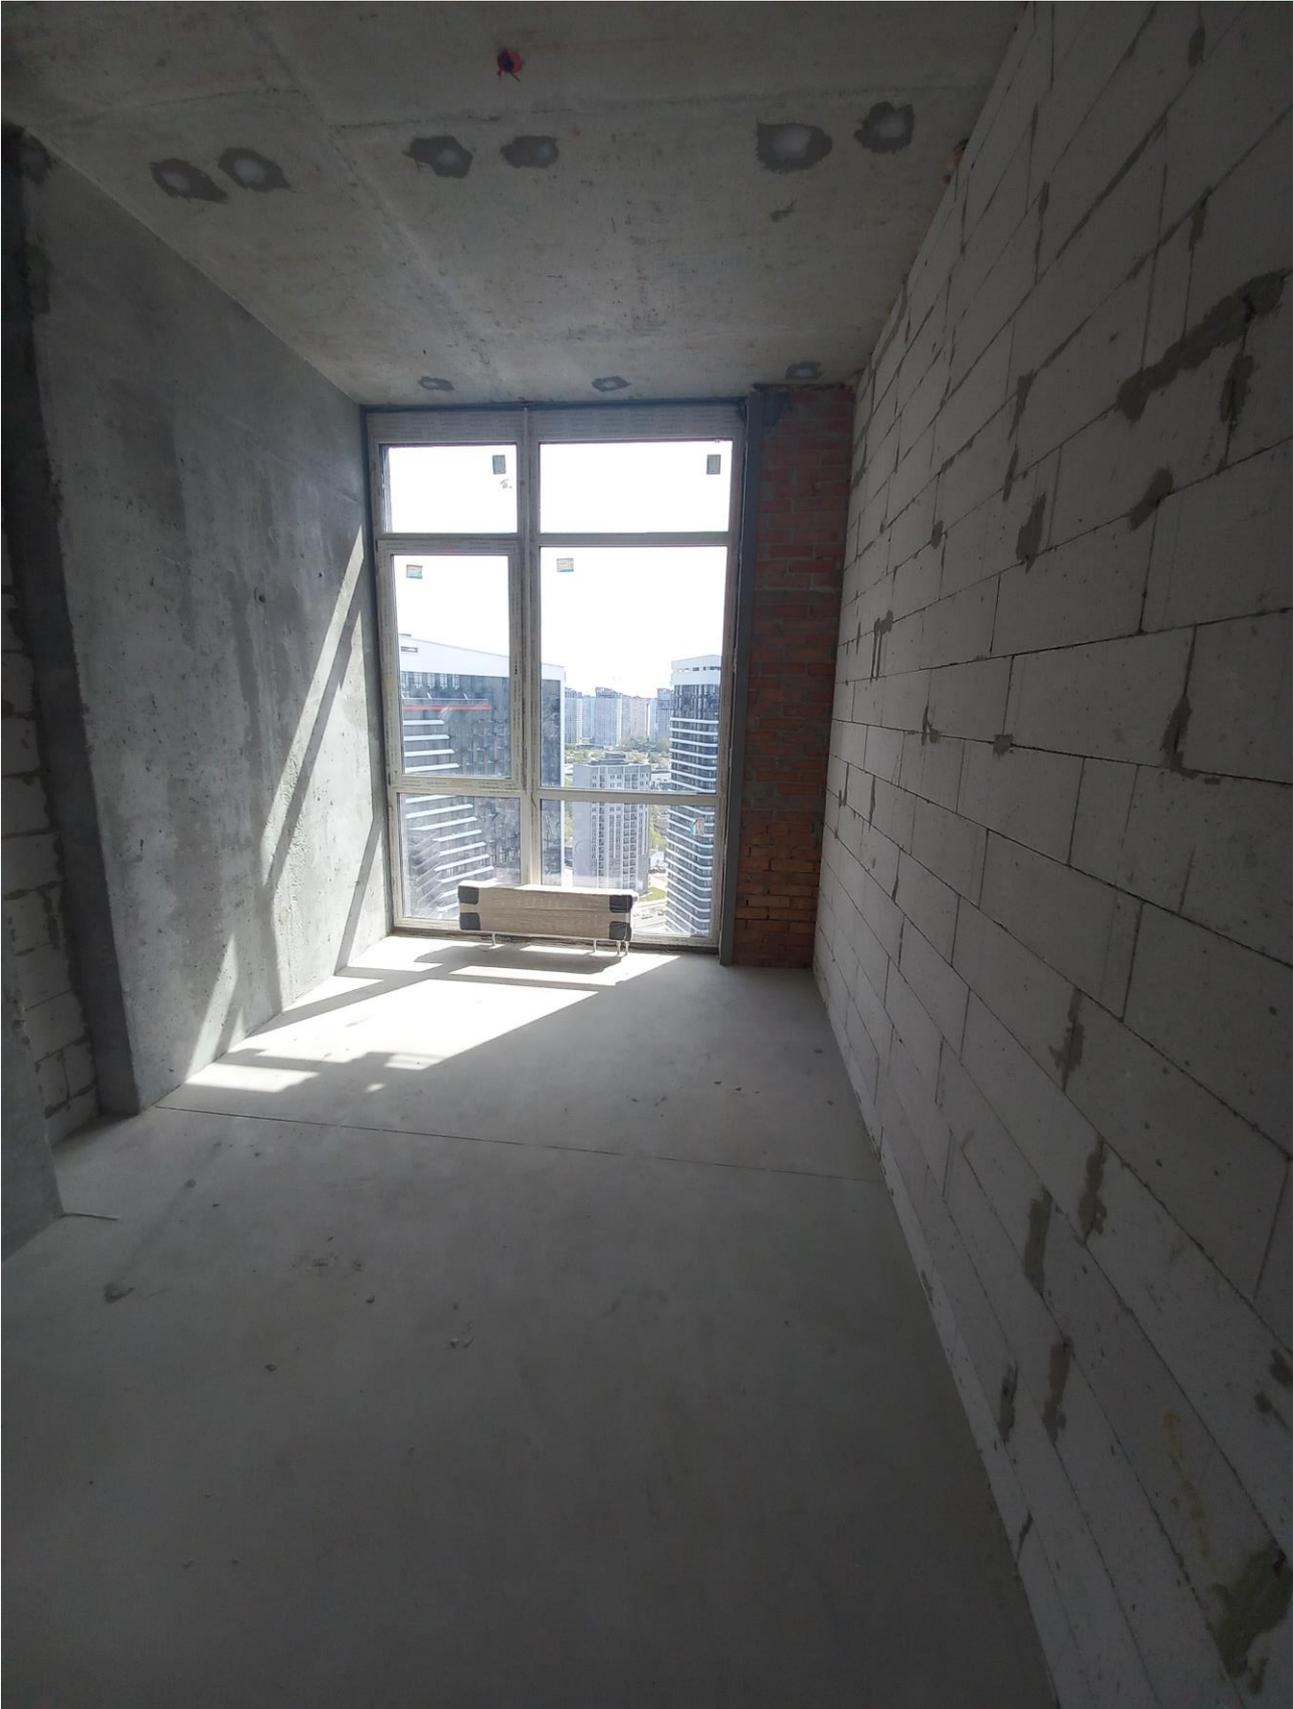
















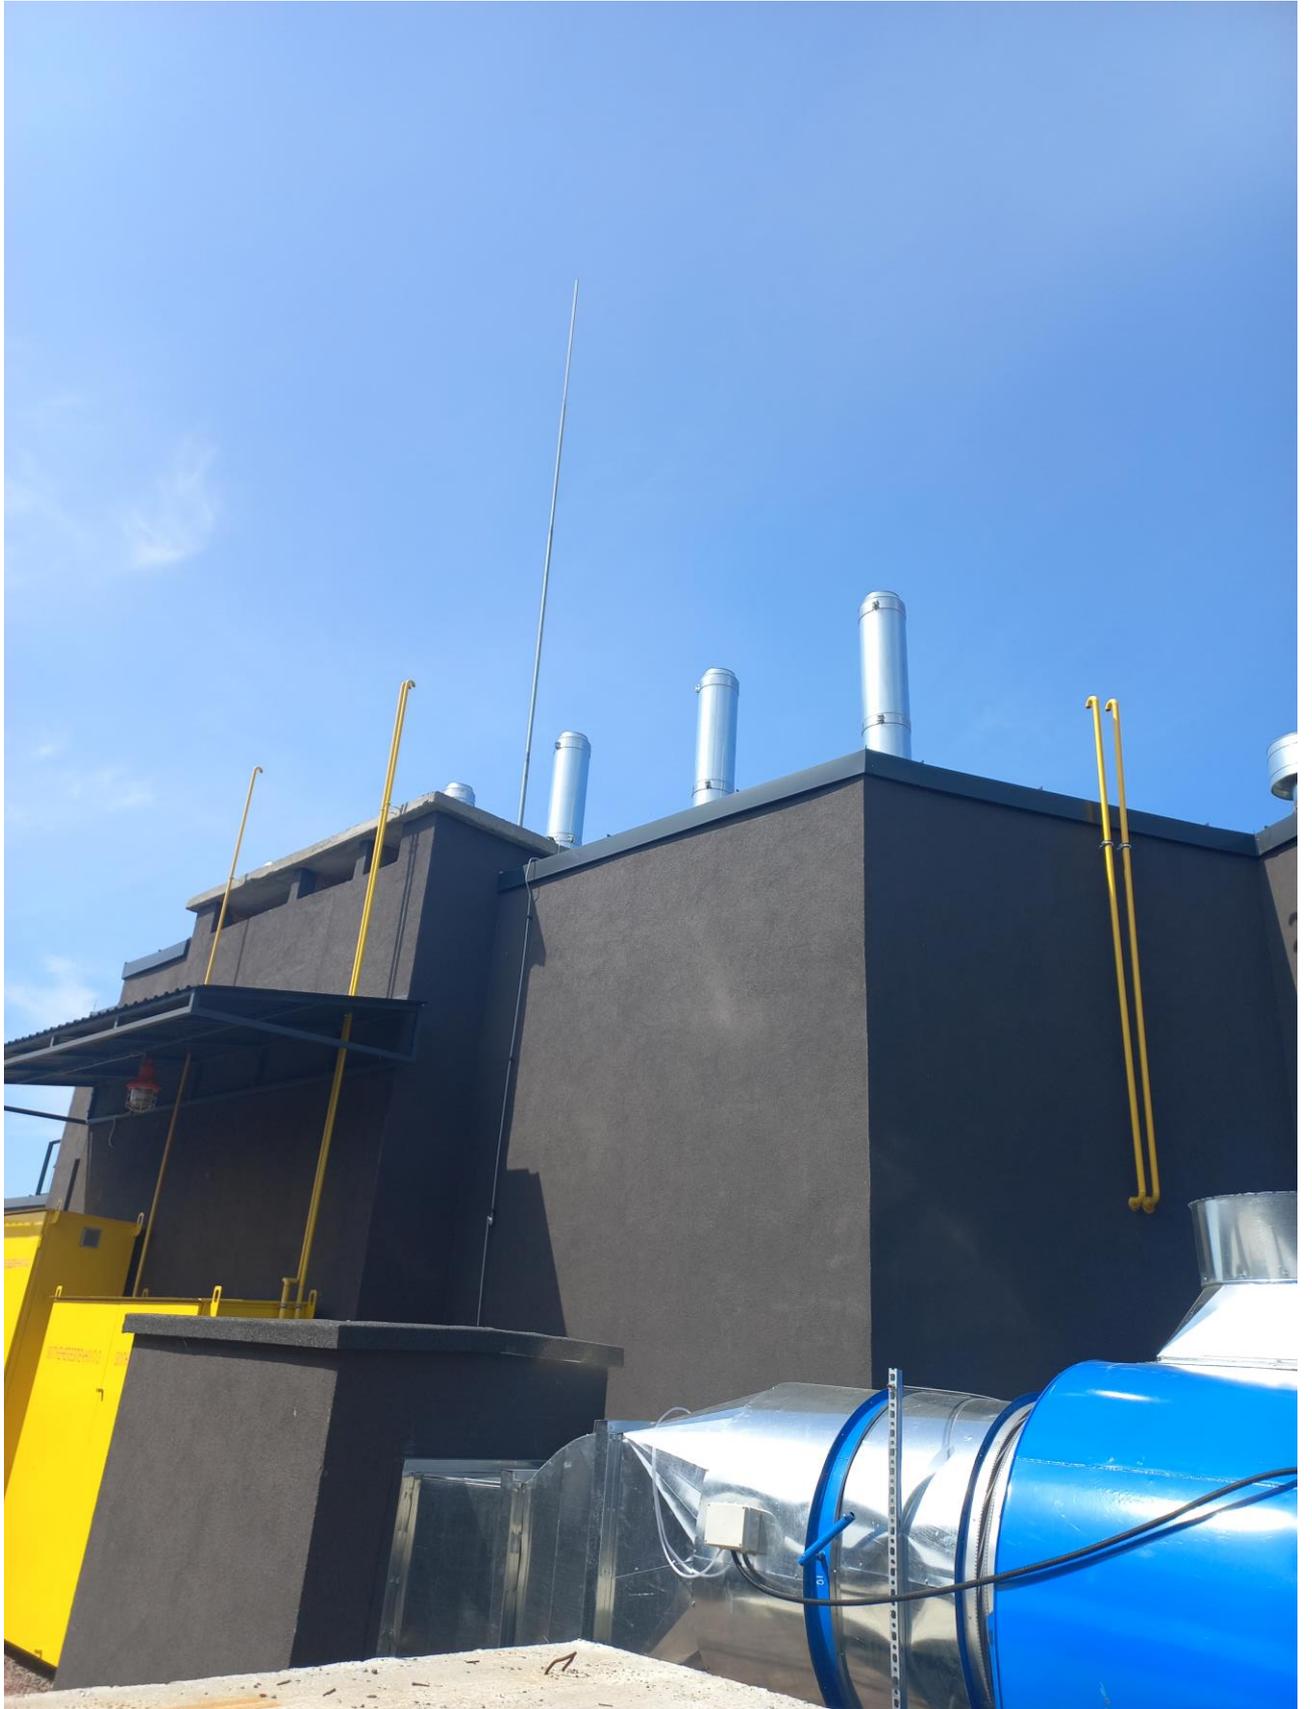







- Нарушение эл.снабжения
- АК разряжен
- Авария насоса
- Контроль линии
- Управление клапаном
- Сброс/гест
- Питание

СИГНАЛ-1


















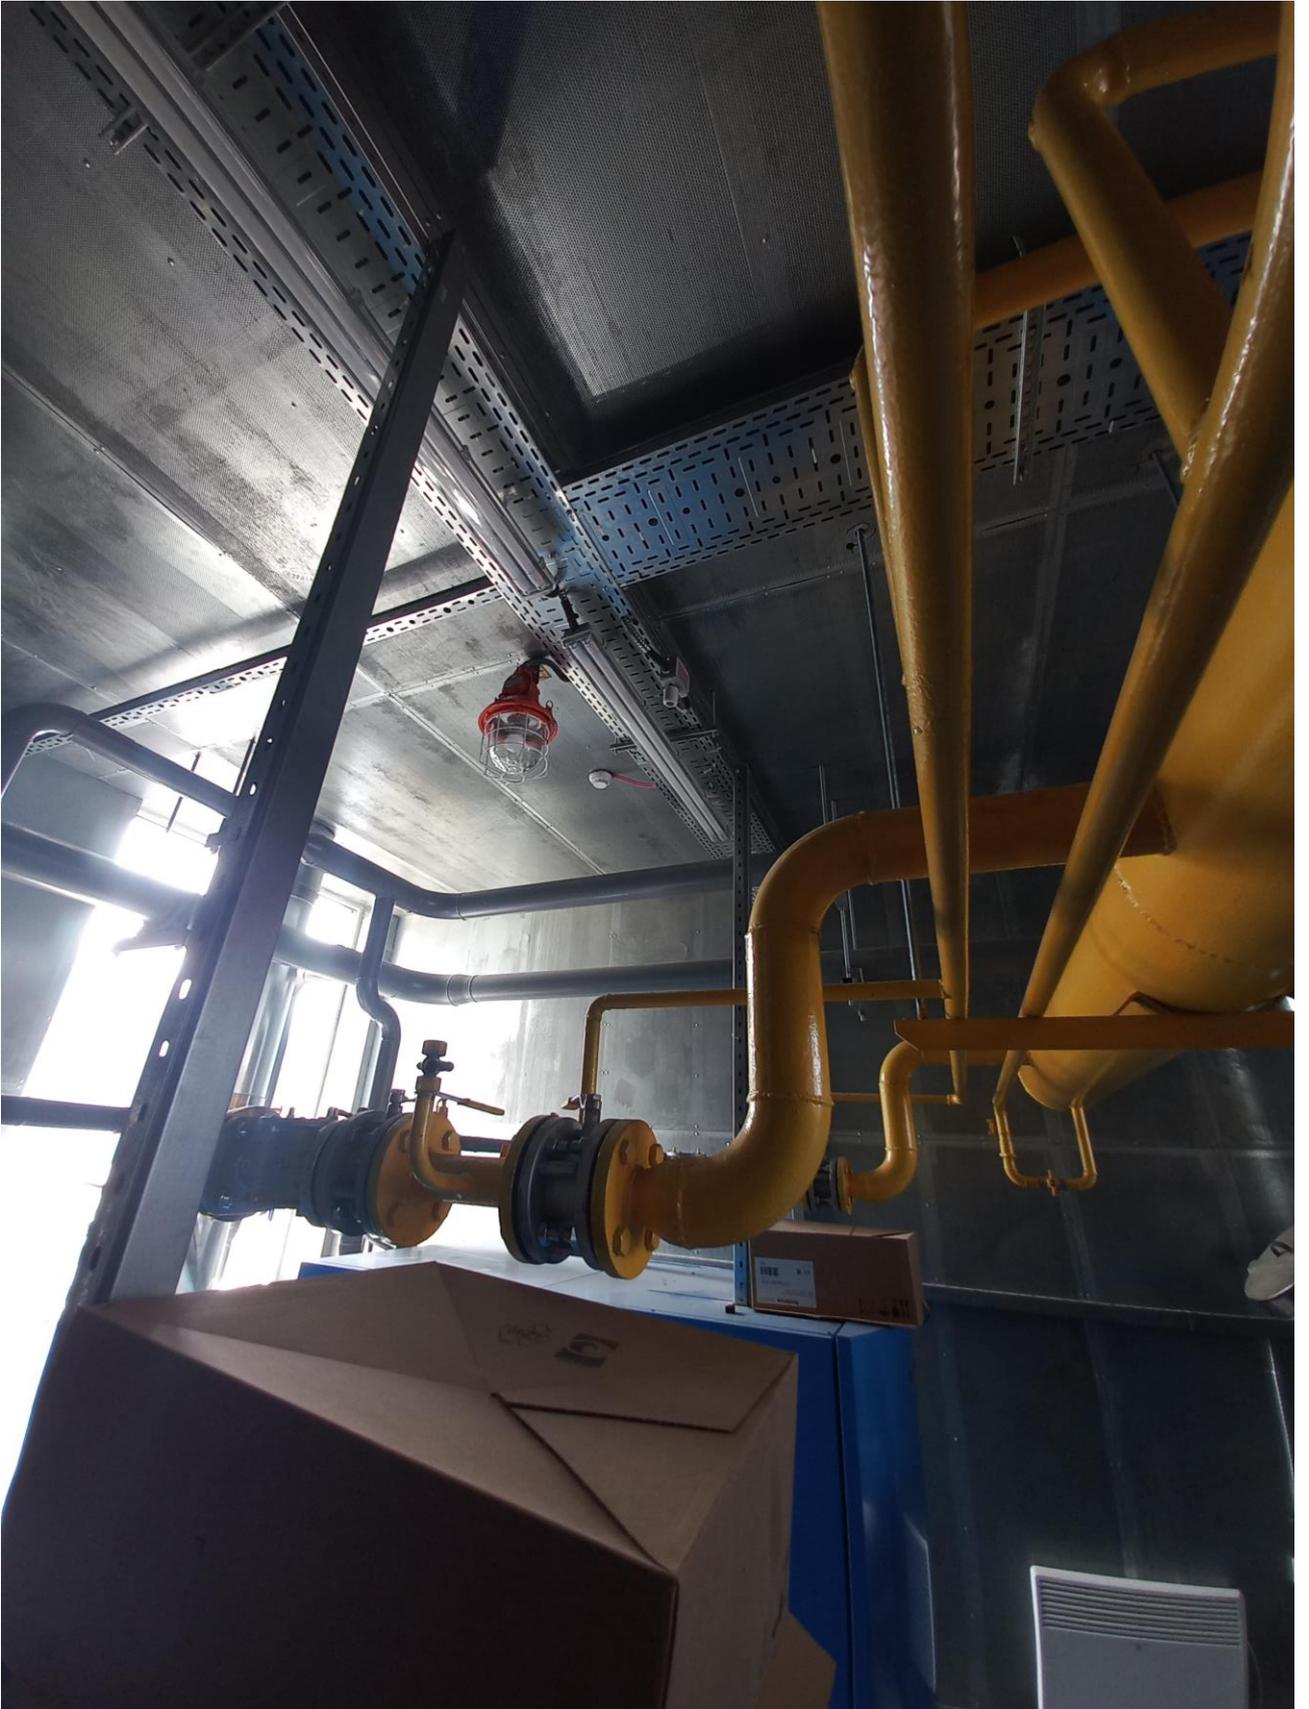










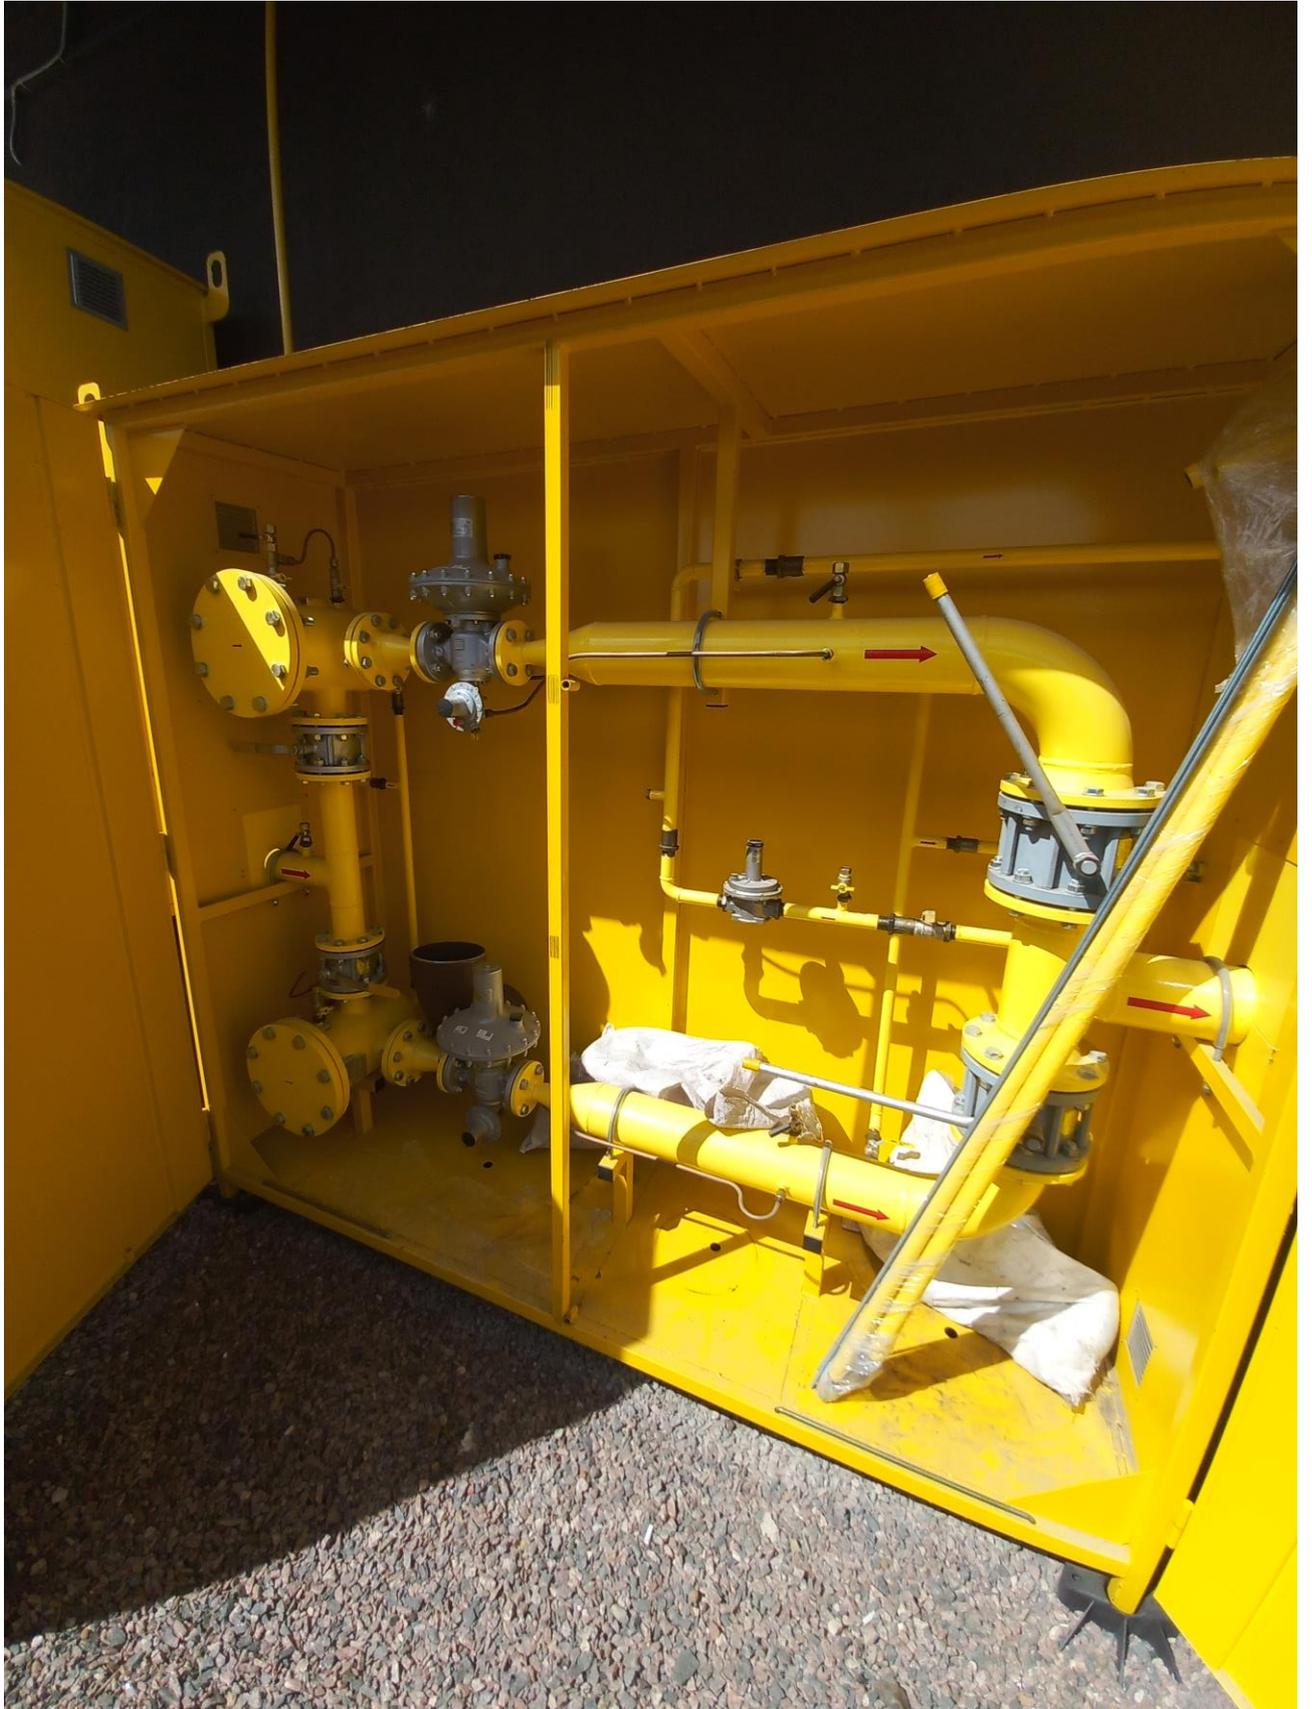

































354



KB. № \_\_\_\_\_

355



KB. № \_\_\_\_\_

356



KB. № \_\_\_\_\_

354




KB. № \_\_\_\_\_

358



KB. № \_\_\_\_\_



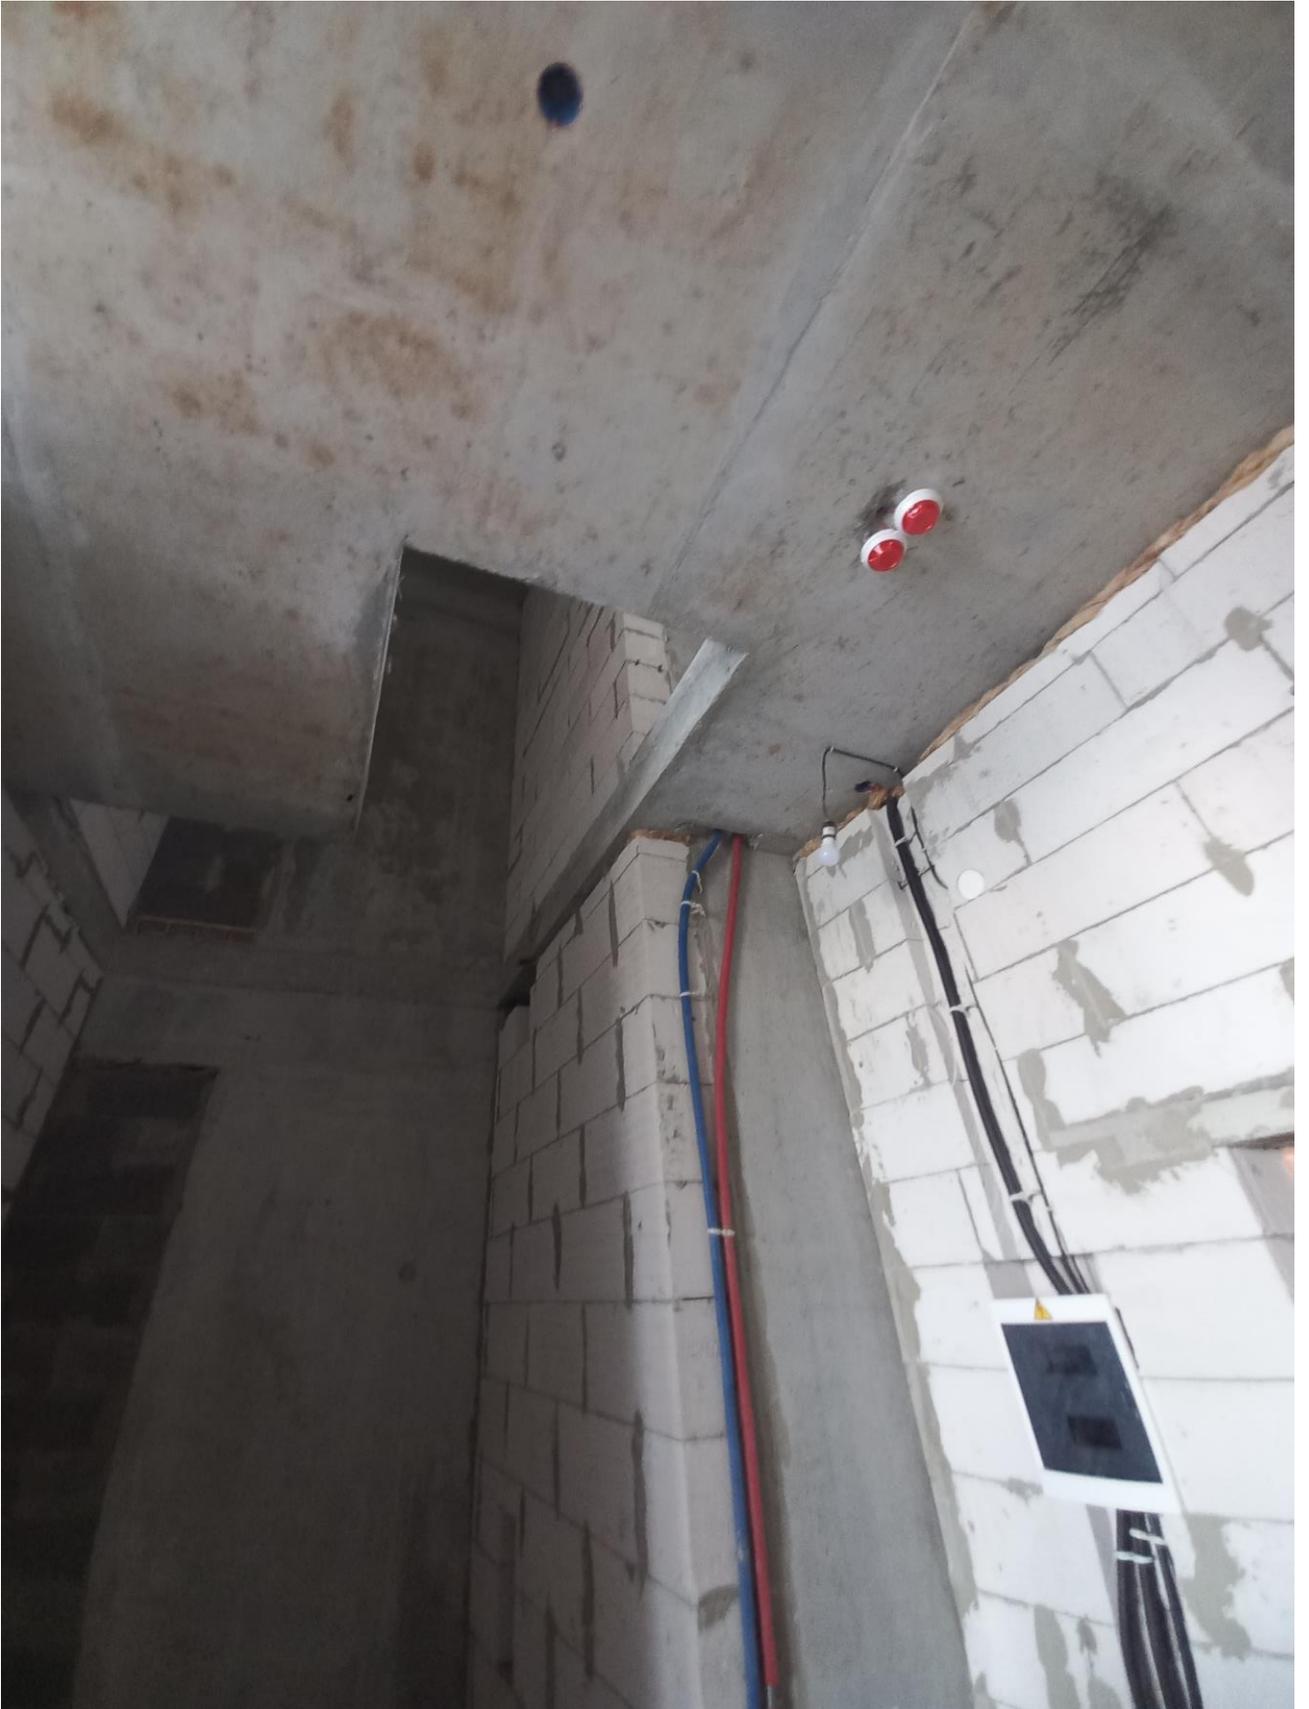




























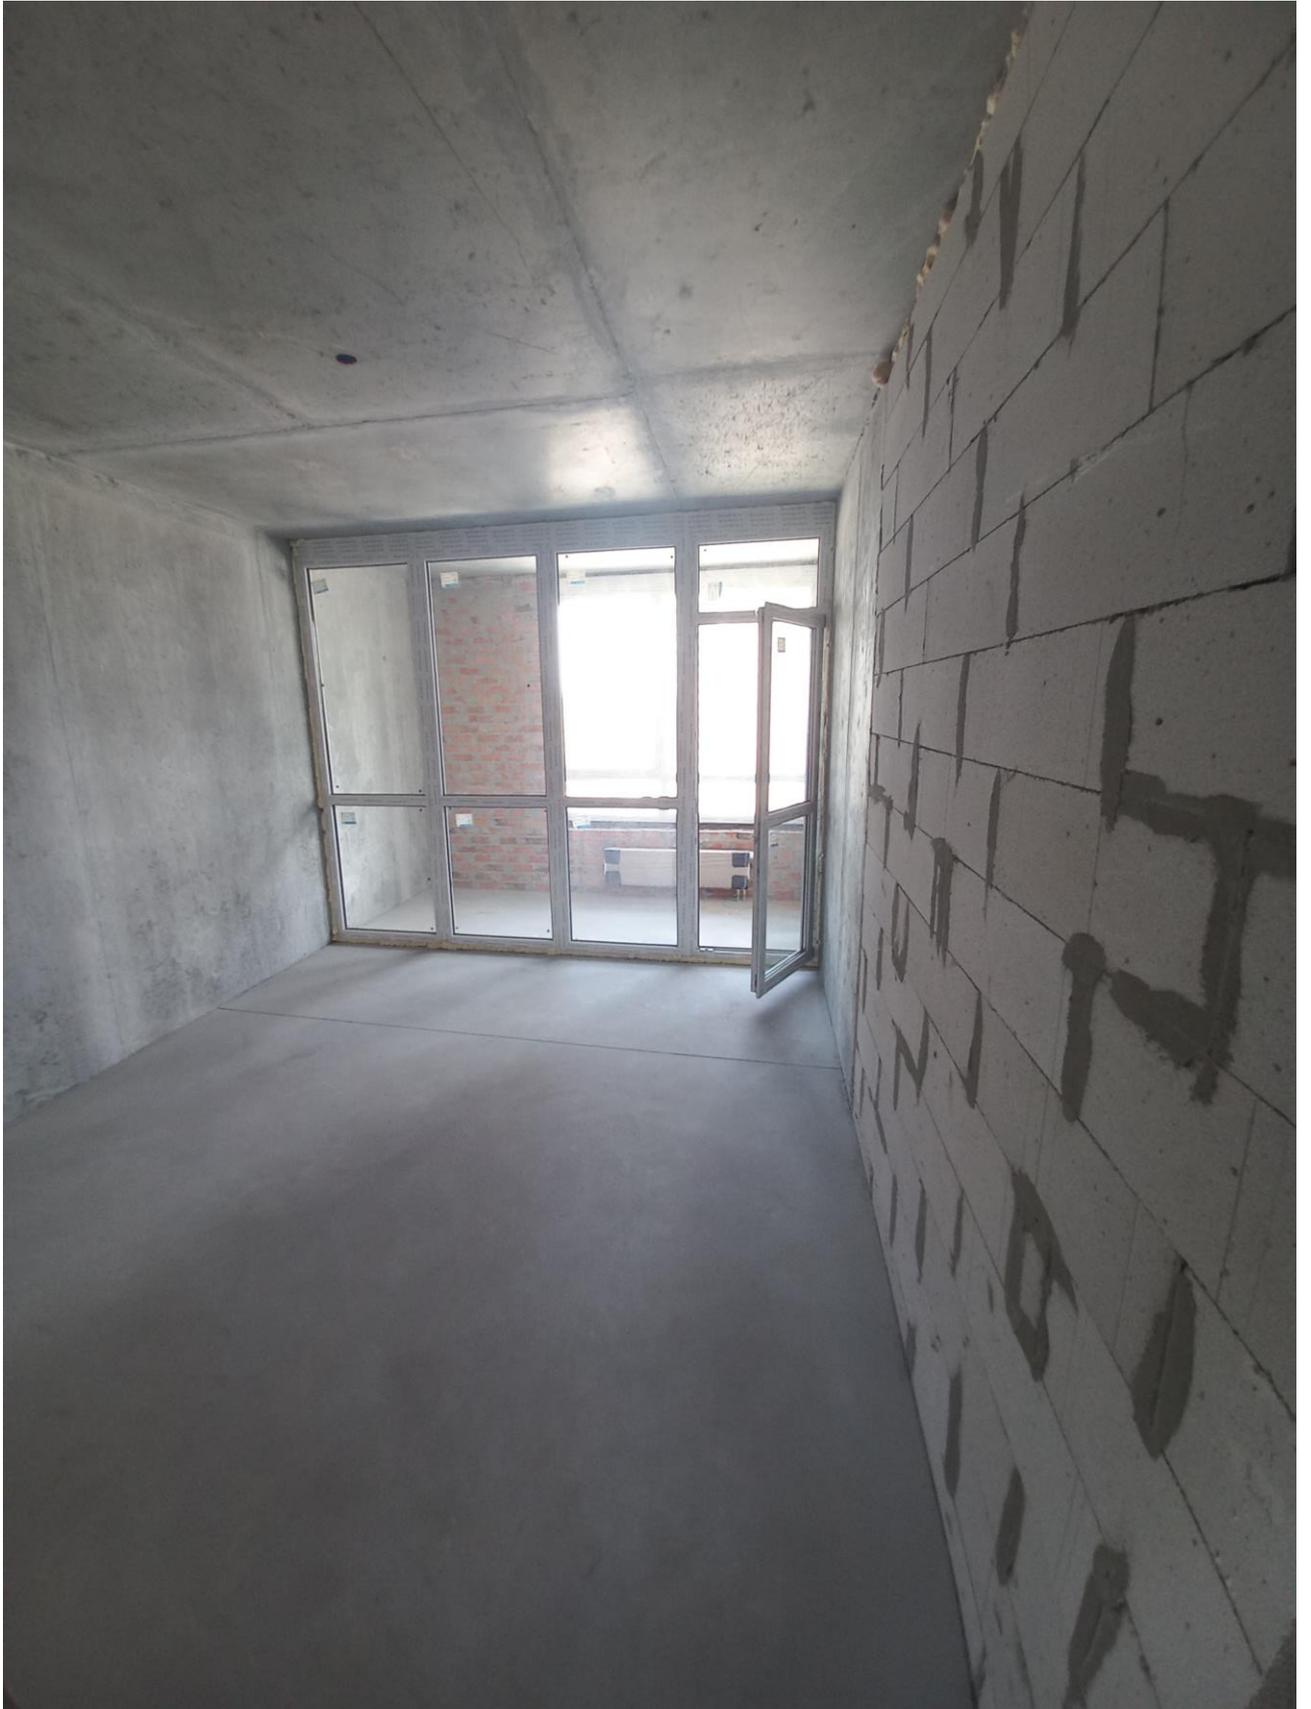

















129



KB. № \_\_\_\_\_

130



KB. № \_\_\_\_\_

132



KB. № \_\_\_\_\_

133



KB. № \_\_\_\_\_

134



KB. № \_\_\_\_\_









119




KB. № \_\_\_\_\_

120




KB. № \_\_\_\_\_

127




KB. № \_\_\_\_\_

128



KB. № \_\_\_\_\_



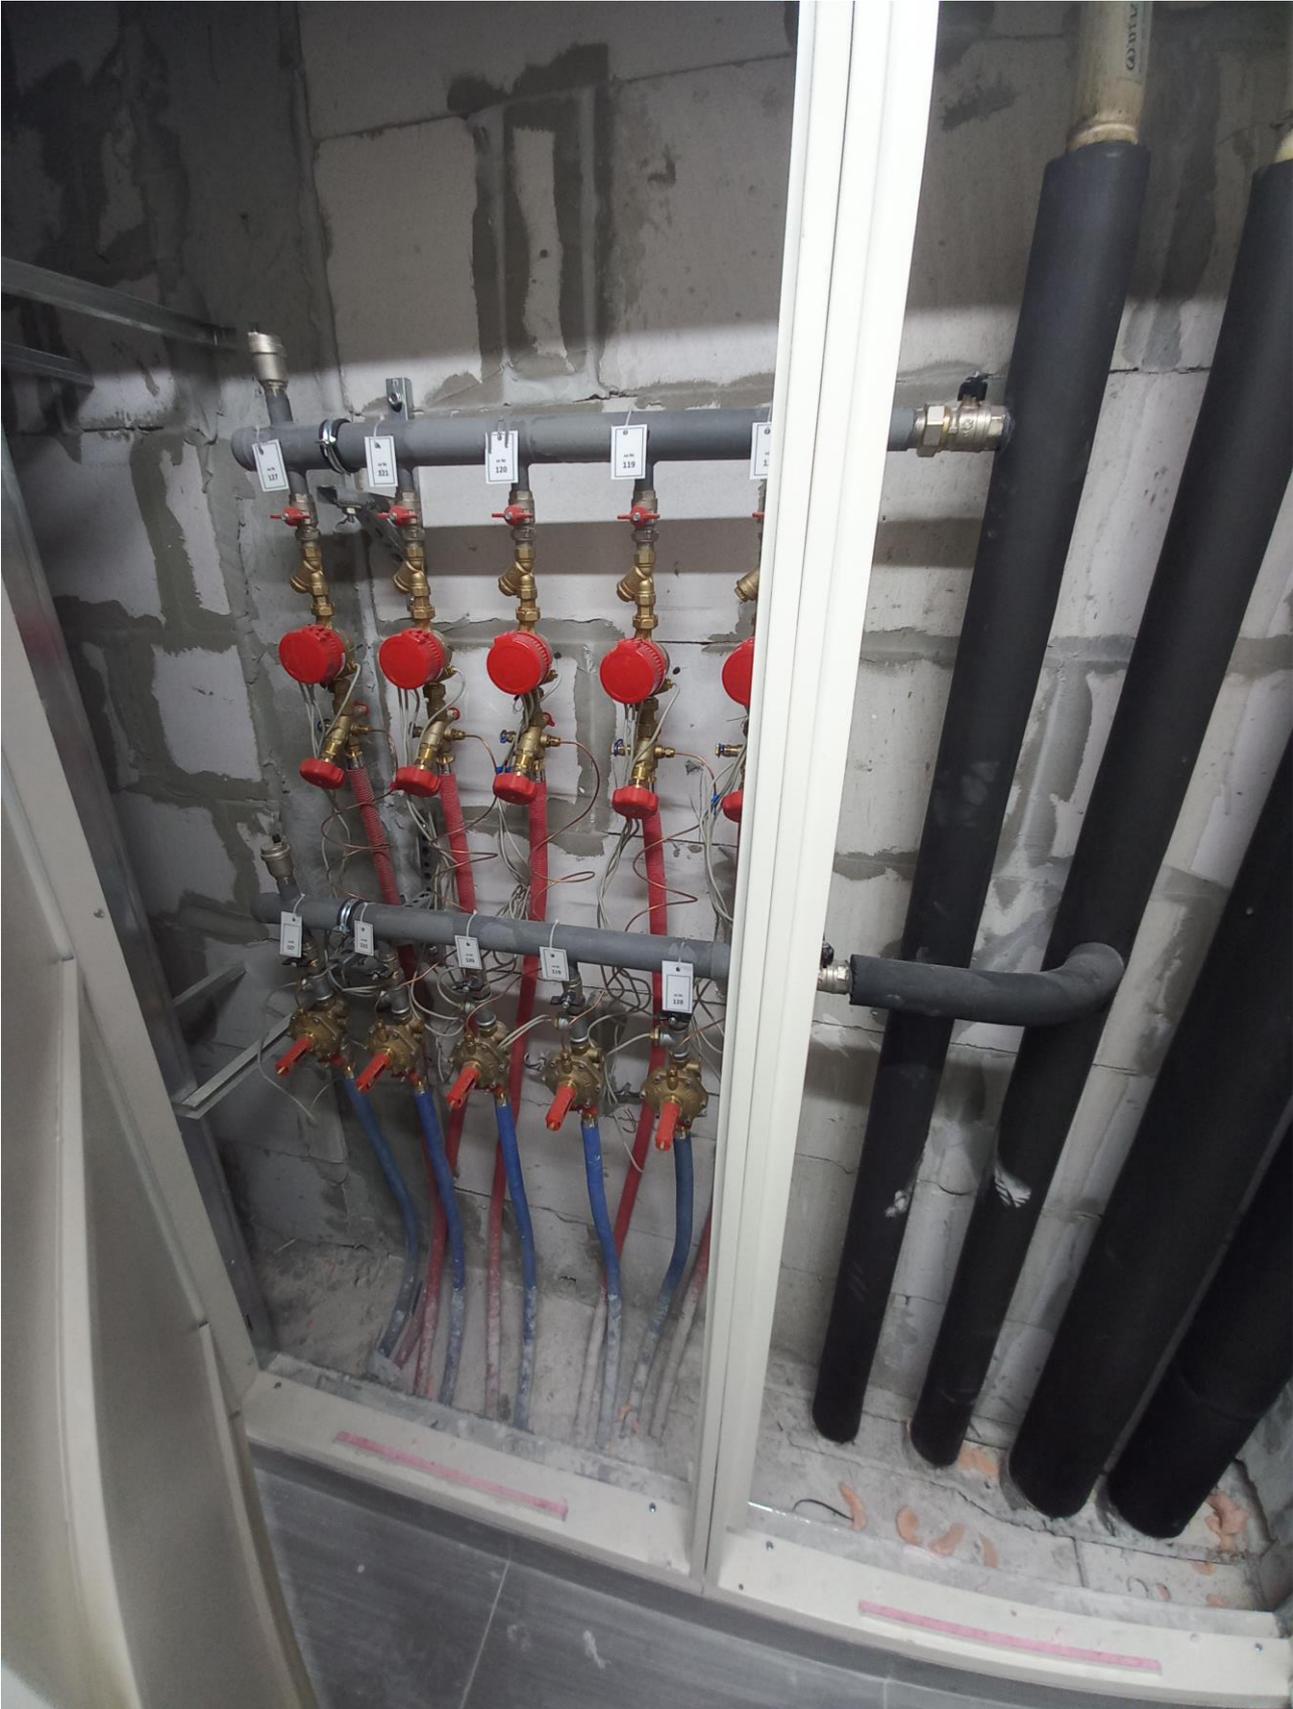




















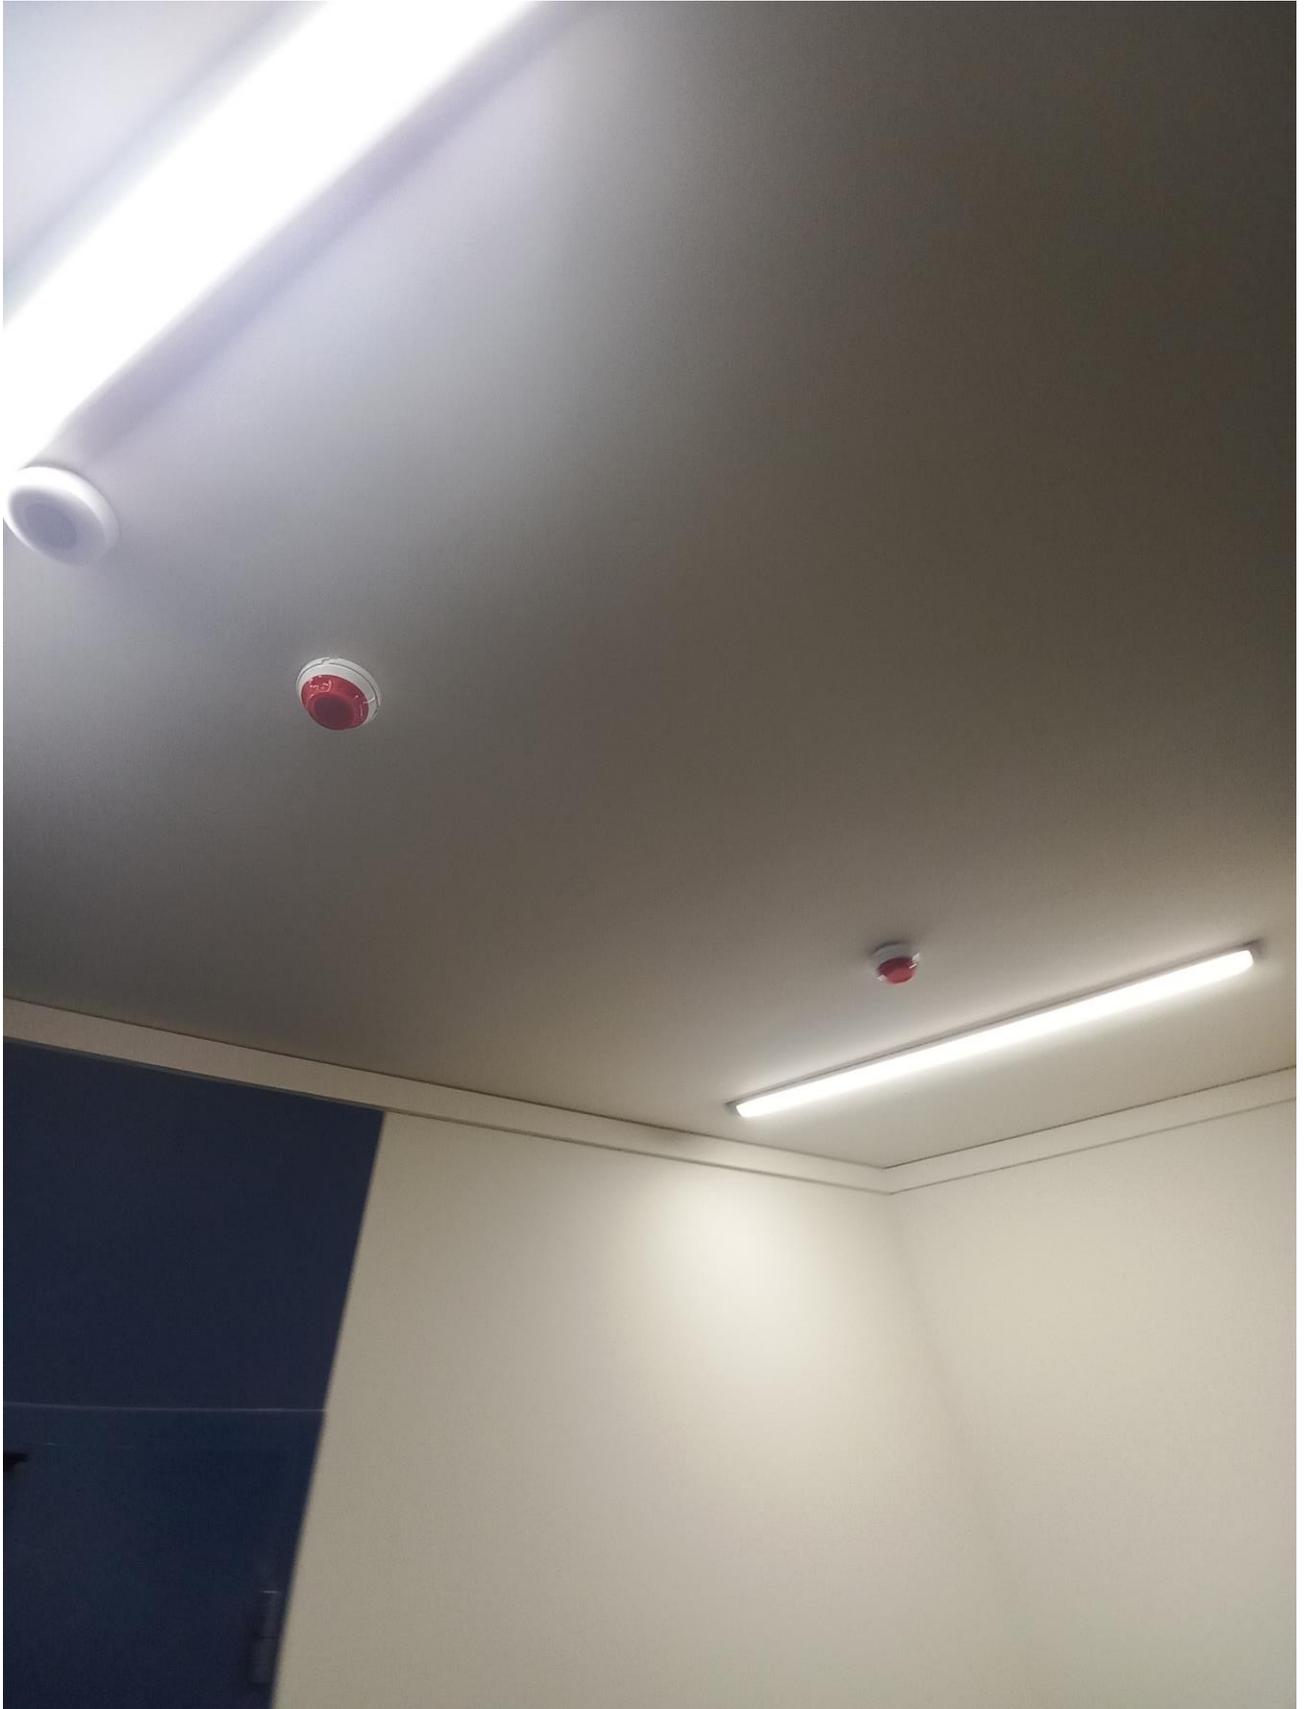




















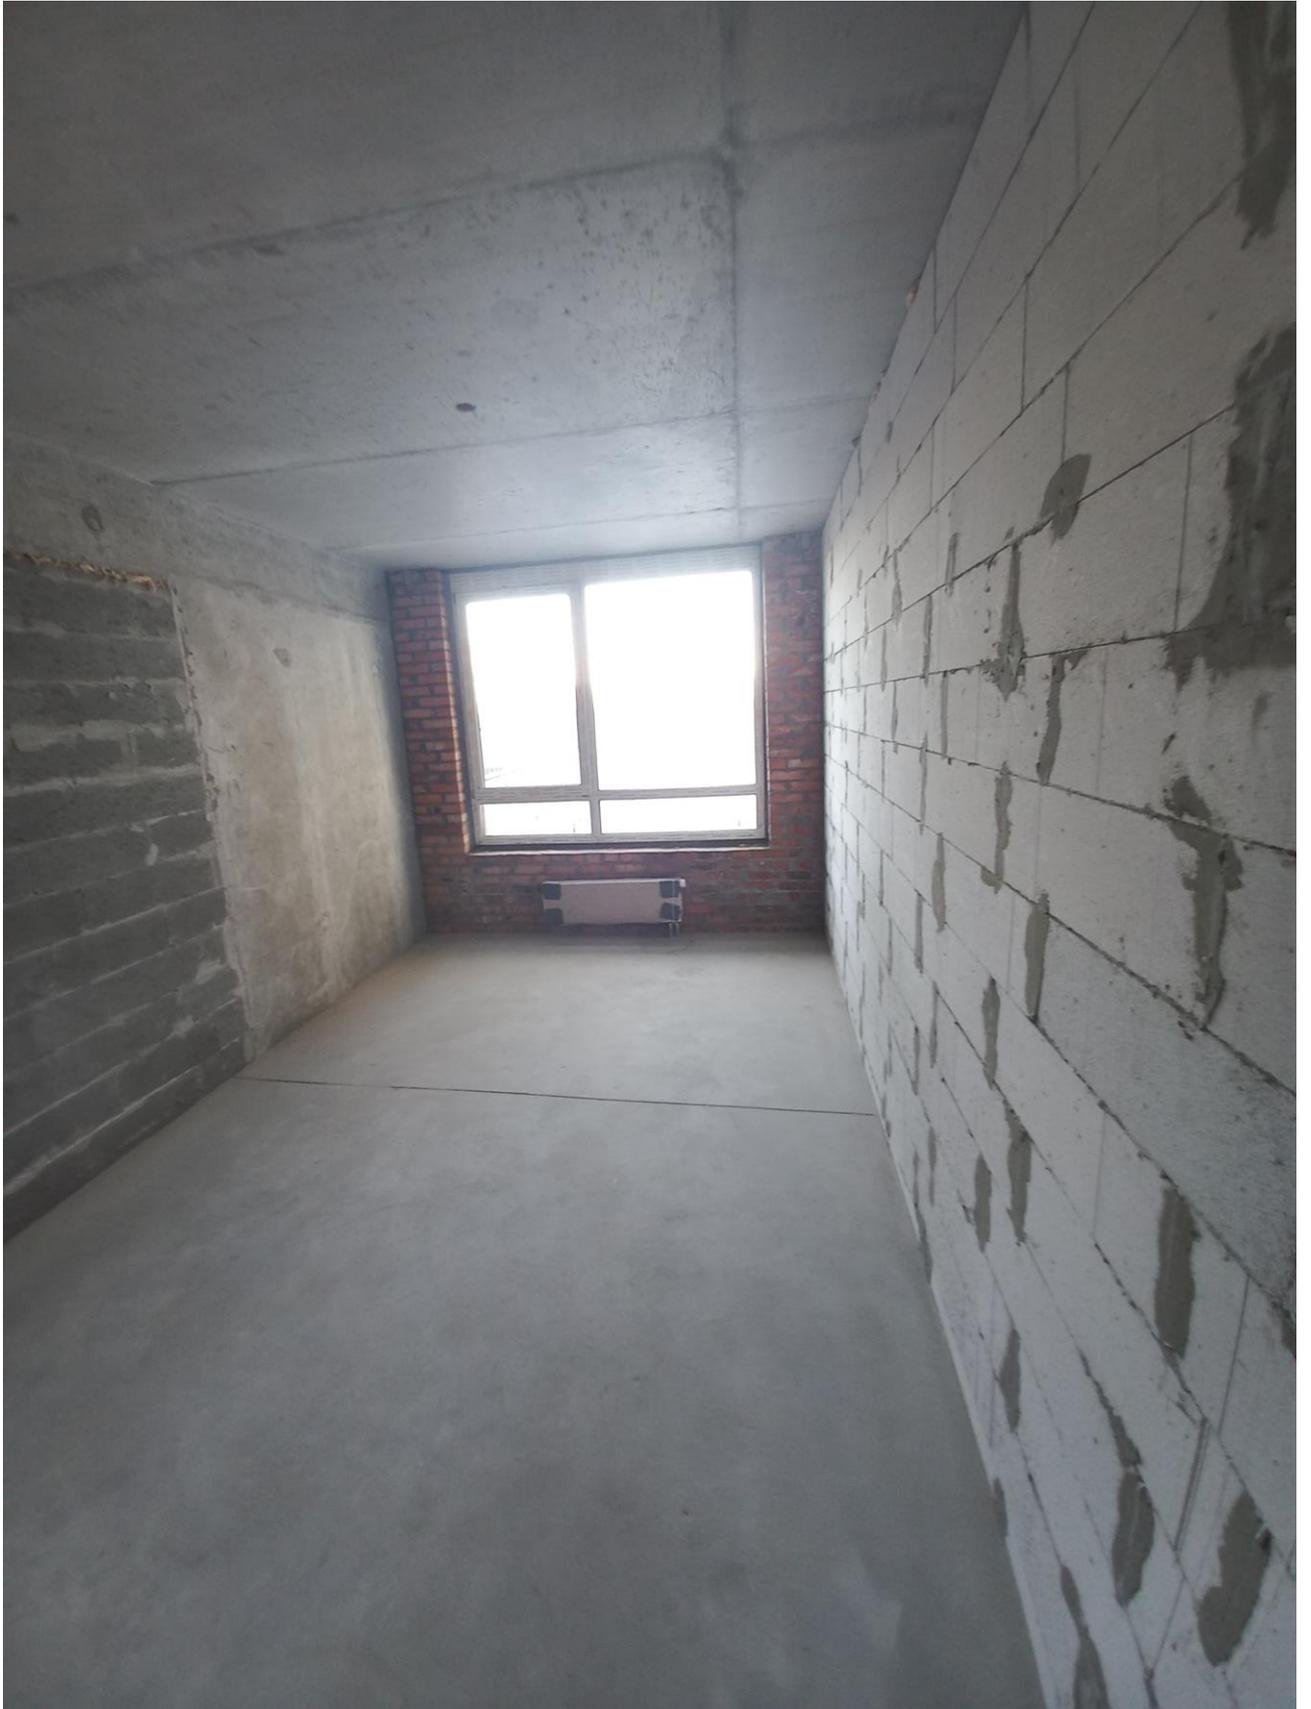







1



KB. № \_\_\_\_\_

2



KB. № \_\_\_\_\_

9



KB. № \_\_\_\_\_

10




KB. № \_\_\_\_\_







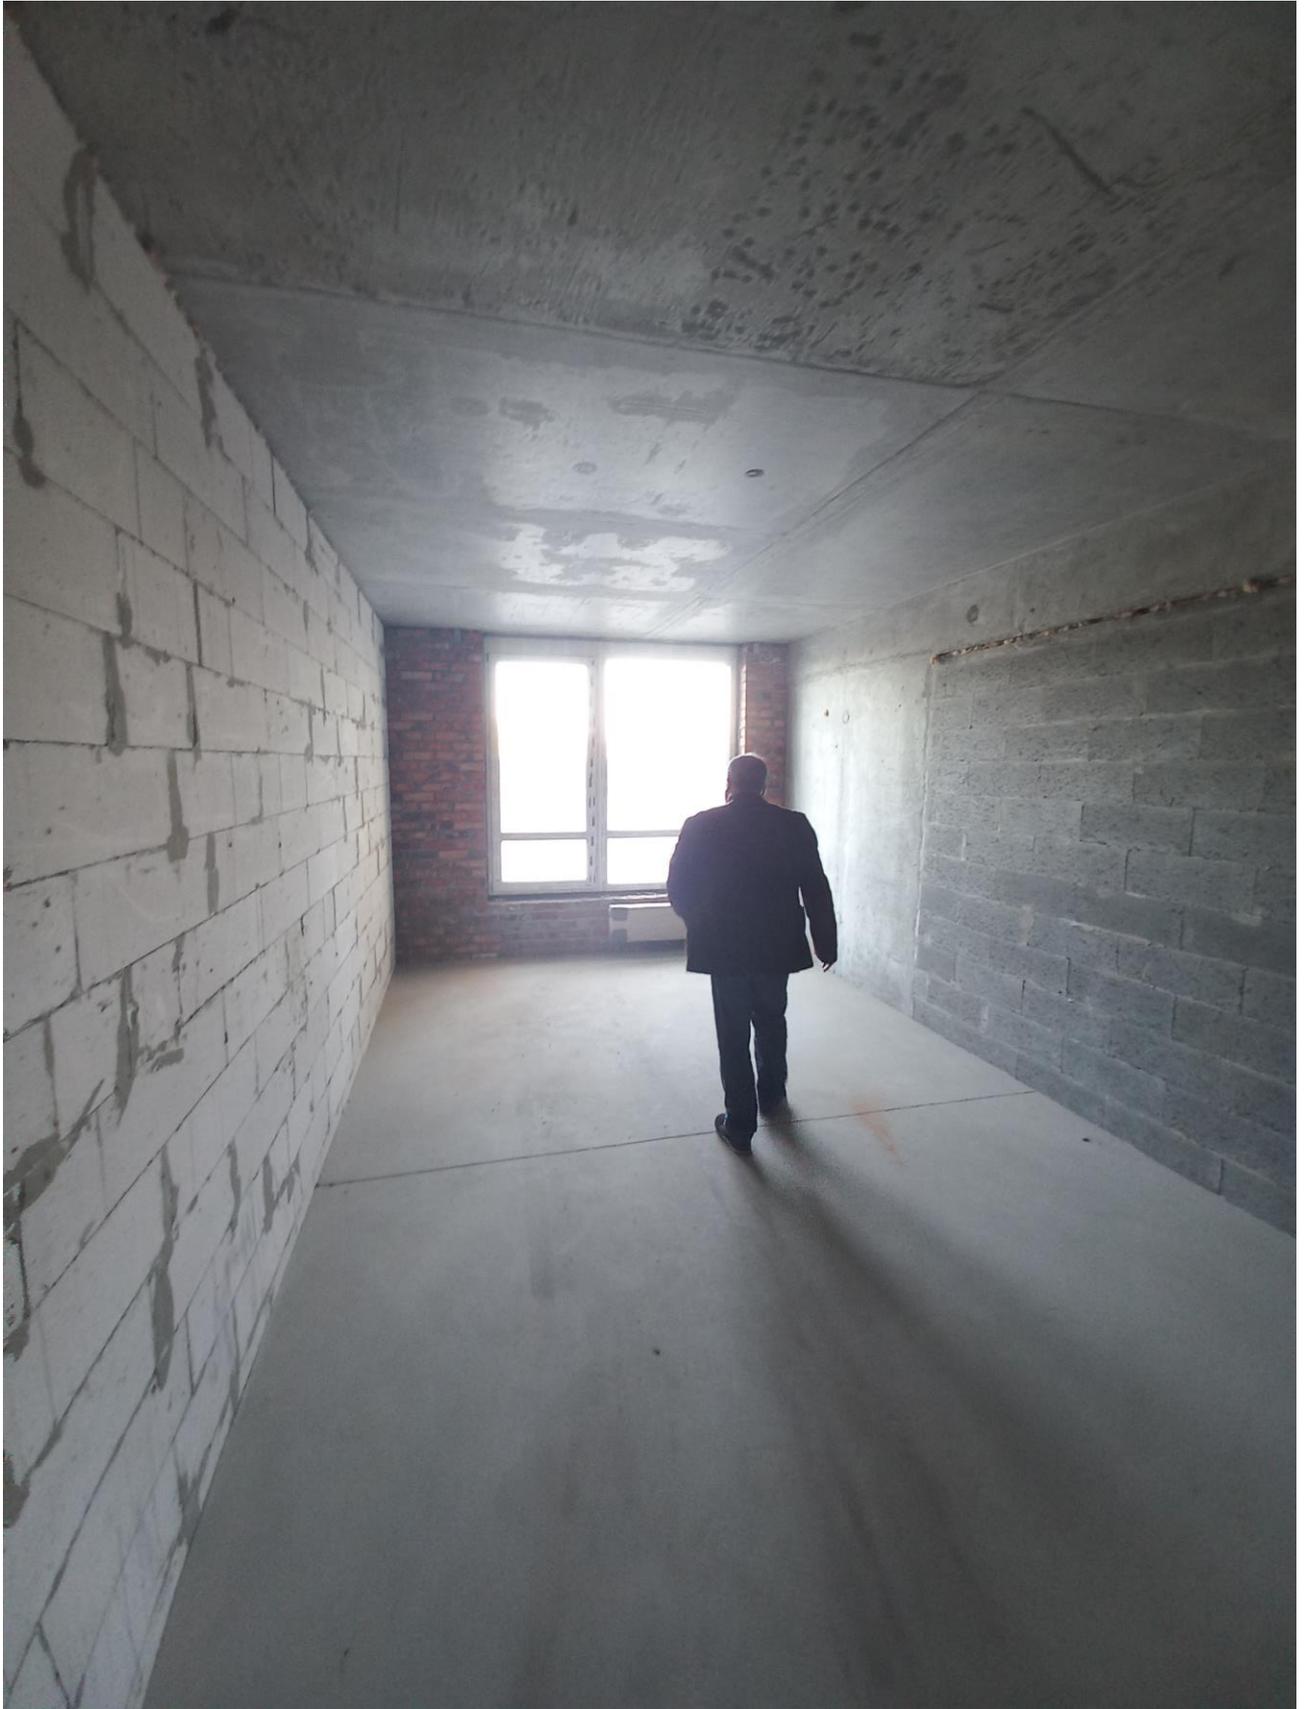



















**СХОДИ  
ВНИЗ**
















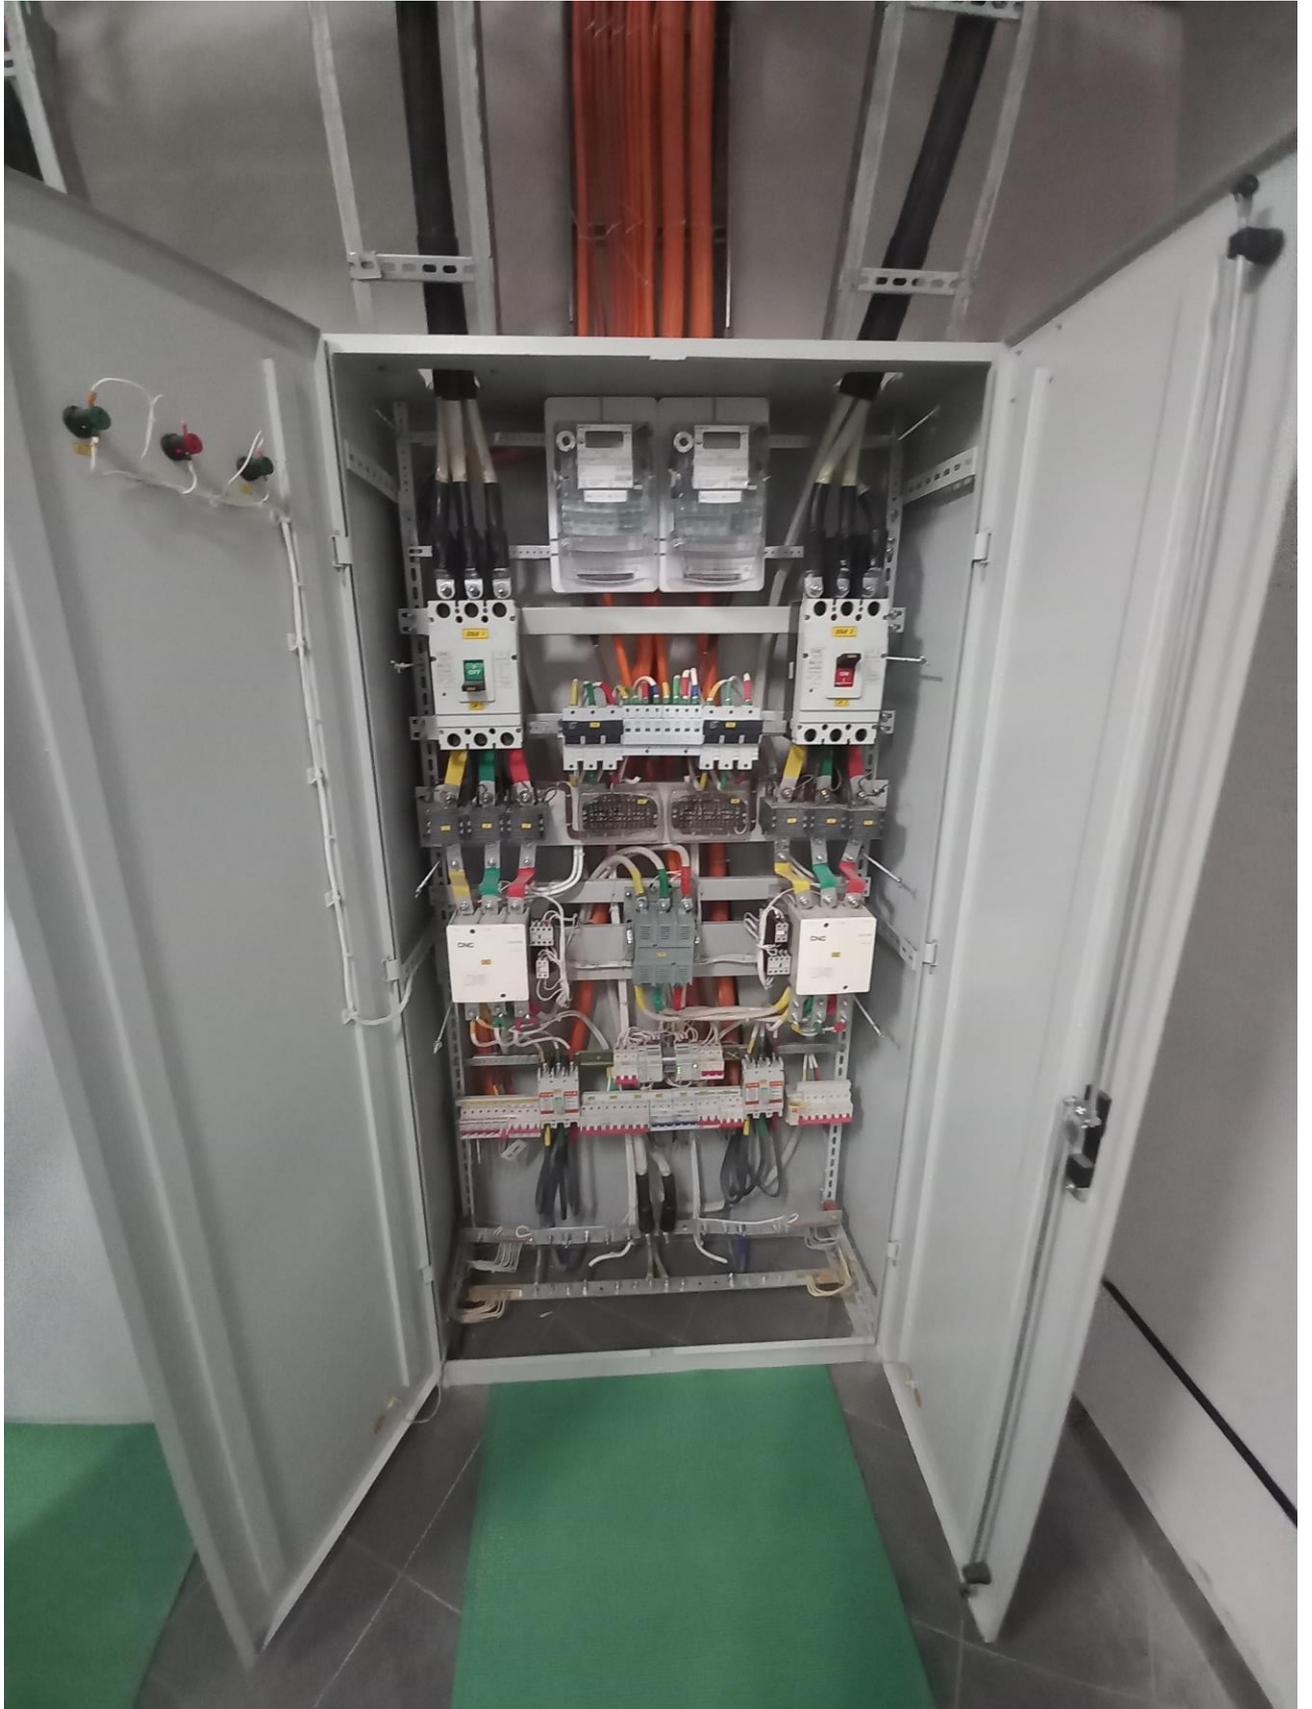


























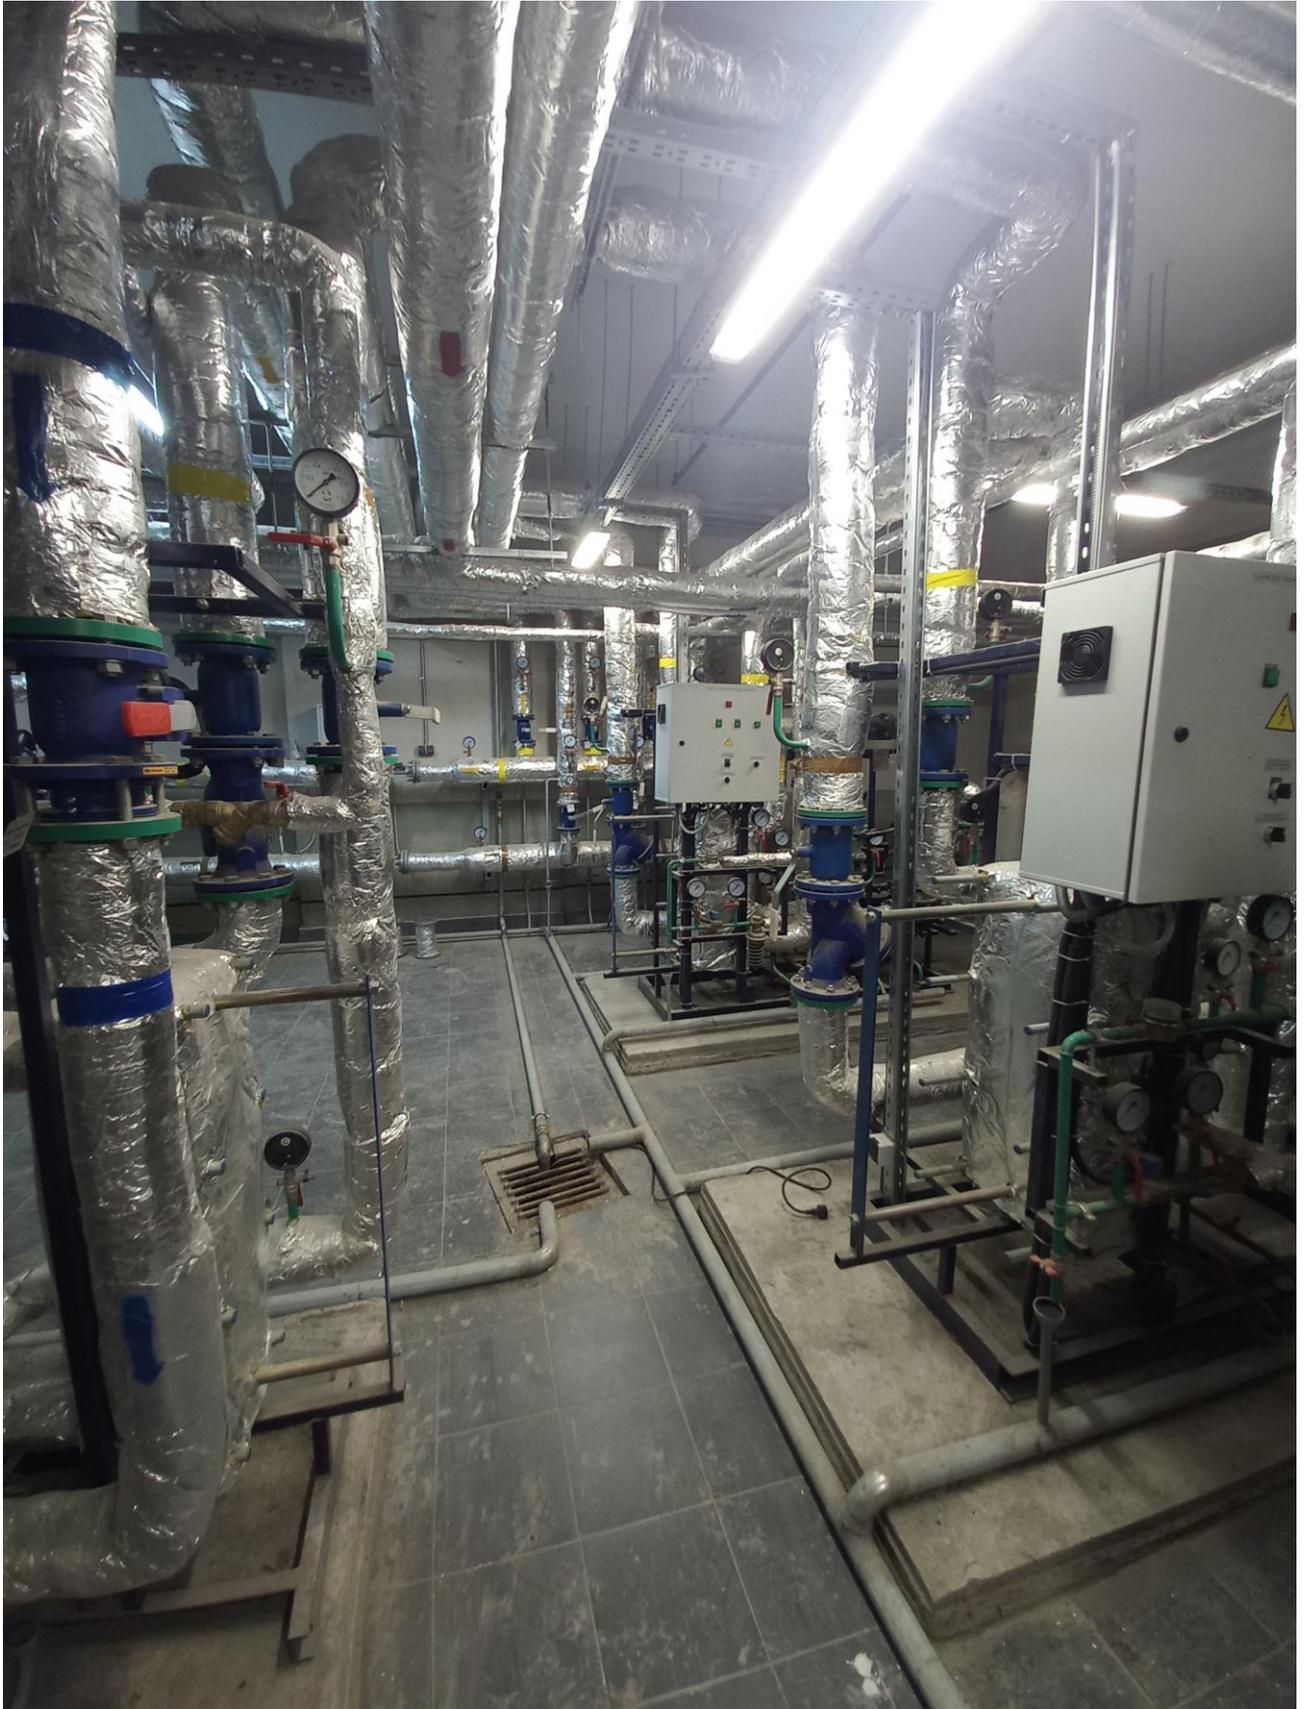




















































22 Варта  
ВАРТА 1-03.14  
ДУГ-14  
12 V  
Увага! відкривати після  
відключення від мережі









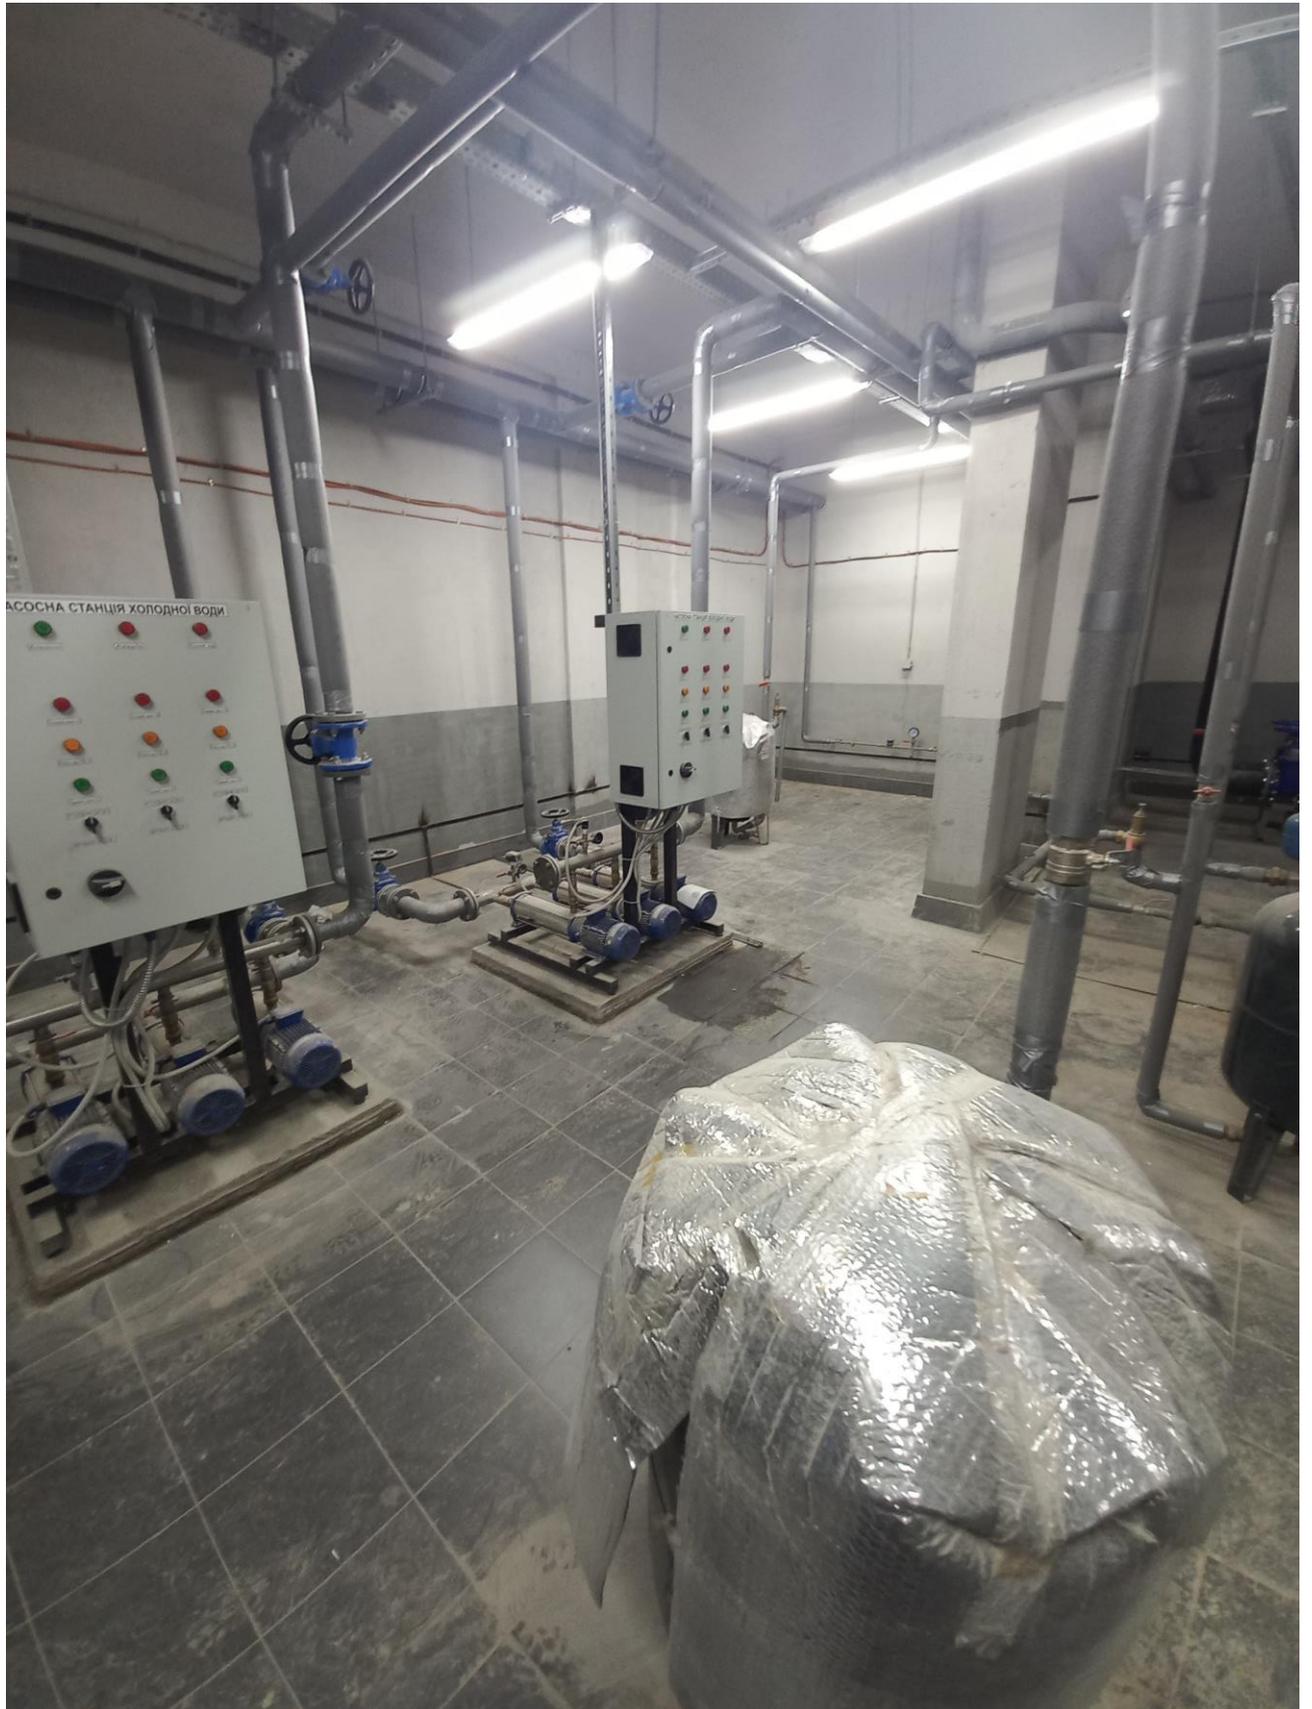







ИВА "ЭЛЕКОН-138"

АВТОМАТИКА СУСТАВОВ

Всё в соответствии с требованиями ГОСТ 19000-90

ИВА "ЭЛЕКОН-138"

MCCB 0 AUTO

Emergency stop button





МЕРКА  
 ВВГ 1 ВВГ 2  
 АВТОМАТИЧЕСКОЕ РЕШЕНИЕ  
 ПОЖАРООПАСНОСТИ  
 НАСОС 1 НАСОС 2  
 ПРОЦЕСС УПРАВЛЕНИЯ  
 НАСОС 1 НАСОС 2  
 РЕГУЛИРОВКА  
 НАСОСОВ  
 ИWT ИТЕПСОБАИ

10 indicator lights (orange and white)

IWT ИТЕПСОБАИ





