















ГАЗ
НЕ ВХОДИТИ!









ГАЗ
НЕ ВХОДИТИ!

→
ВХІД

ПРОБЛЕМА
ВХОДУ









OMEGA
FAMMA M57M 180-1204

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204

MPTA C-03.14

OMEGA
FULL ENERGY

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204

OMEGA
M57M 180-1204



УВАГА!
УСІ ЛАБОРИТИ ПРИЩЕПЕНІ!
АВАРИЙНИЙ ВИТІК ГАЗУ.
ВИБІЖТЕ СІДІТЬ 104.

ДОШКА ОГЛОШЕНЬ
ДОШКА ОГЛОШЕНЬ







- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24

↑↓
♿
♿
ЛИФТ

1



ЗАПУСК ПОЖЕЖНИХ НАСОСІВ
ПУСК СИСТЕМИ ДИМОВИДАЛЕННЯ





ПОЖЕЖА



205







ЗАПУСК ПОЖЕЖНИХ НАСОСІВ

ПУСК СИСТЕМИ ДИМОВИДАЛЕННЯ





ВИХІД









ПОЖЕЖА

A large, grey metal cabinet mounted on the wall. It features five rectangular viewing windows arranged in two rows: three in the top row and two in the bottom row. A black handle is located on the right side of the cabinet. The cabinet is secured with two screws on the right edge.

A smaller, grey metal cabinet mounted on the wall. It has a single rectangular viewing window and a small black handle on the right side. It is secured with a single screw on the right edge.

A white fire door set in a wall. It has a vertical black handle on the right side. A blue and red label is visible on the top left corner of the door. The door is slightly ajar, revealing a dark interior.













204 205 206 207





Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C

Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C

Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C

Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C

Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C

Misa
Pulsar mini DM
Q: 0.01 m³/h
Q: 0.01 m³/h
Q: 1.2 m³/h
M: 0.01 C
M: 0.01 C
M: 0.01 C
M: 0.01 C










« 114 109 »
117 14 113

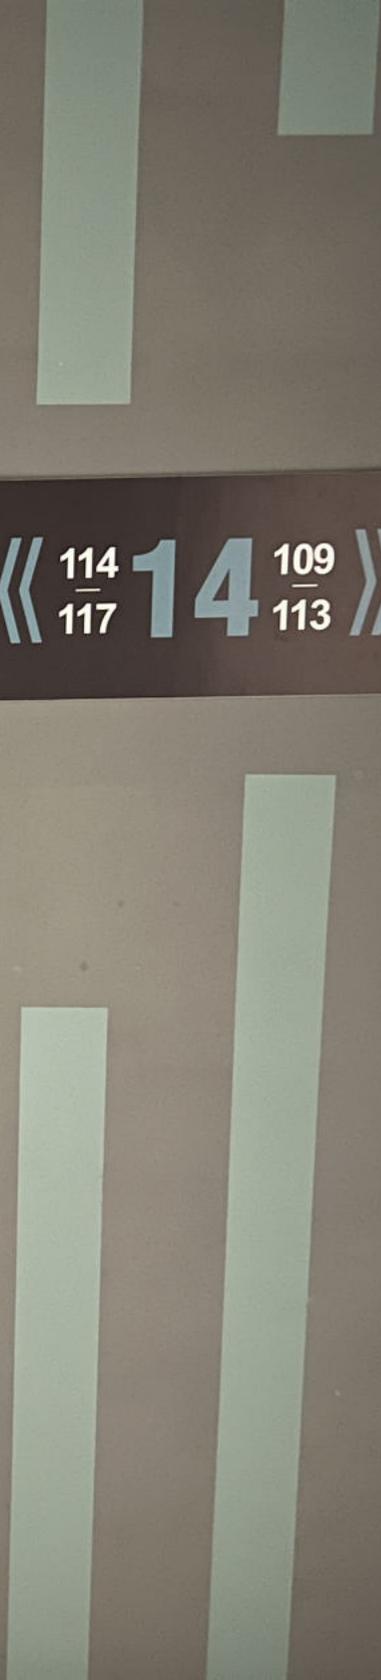














113





ПОЖЕЖА

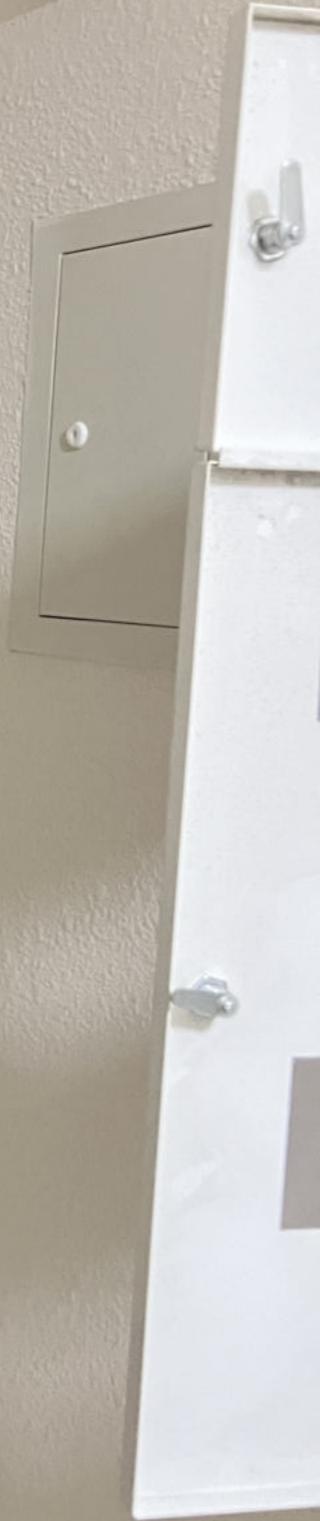



143T



ПОЖЕЖА

















7




no





6 7 8 9



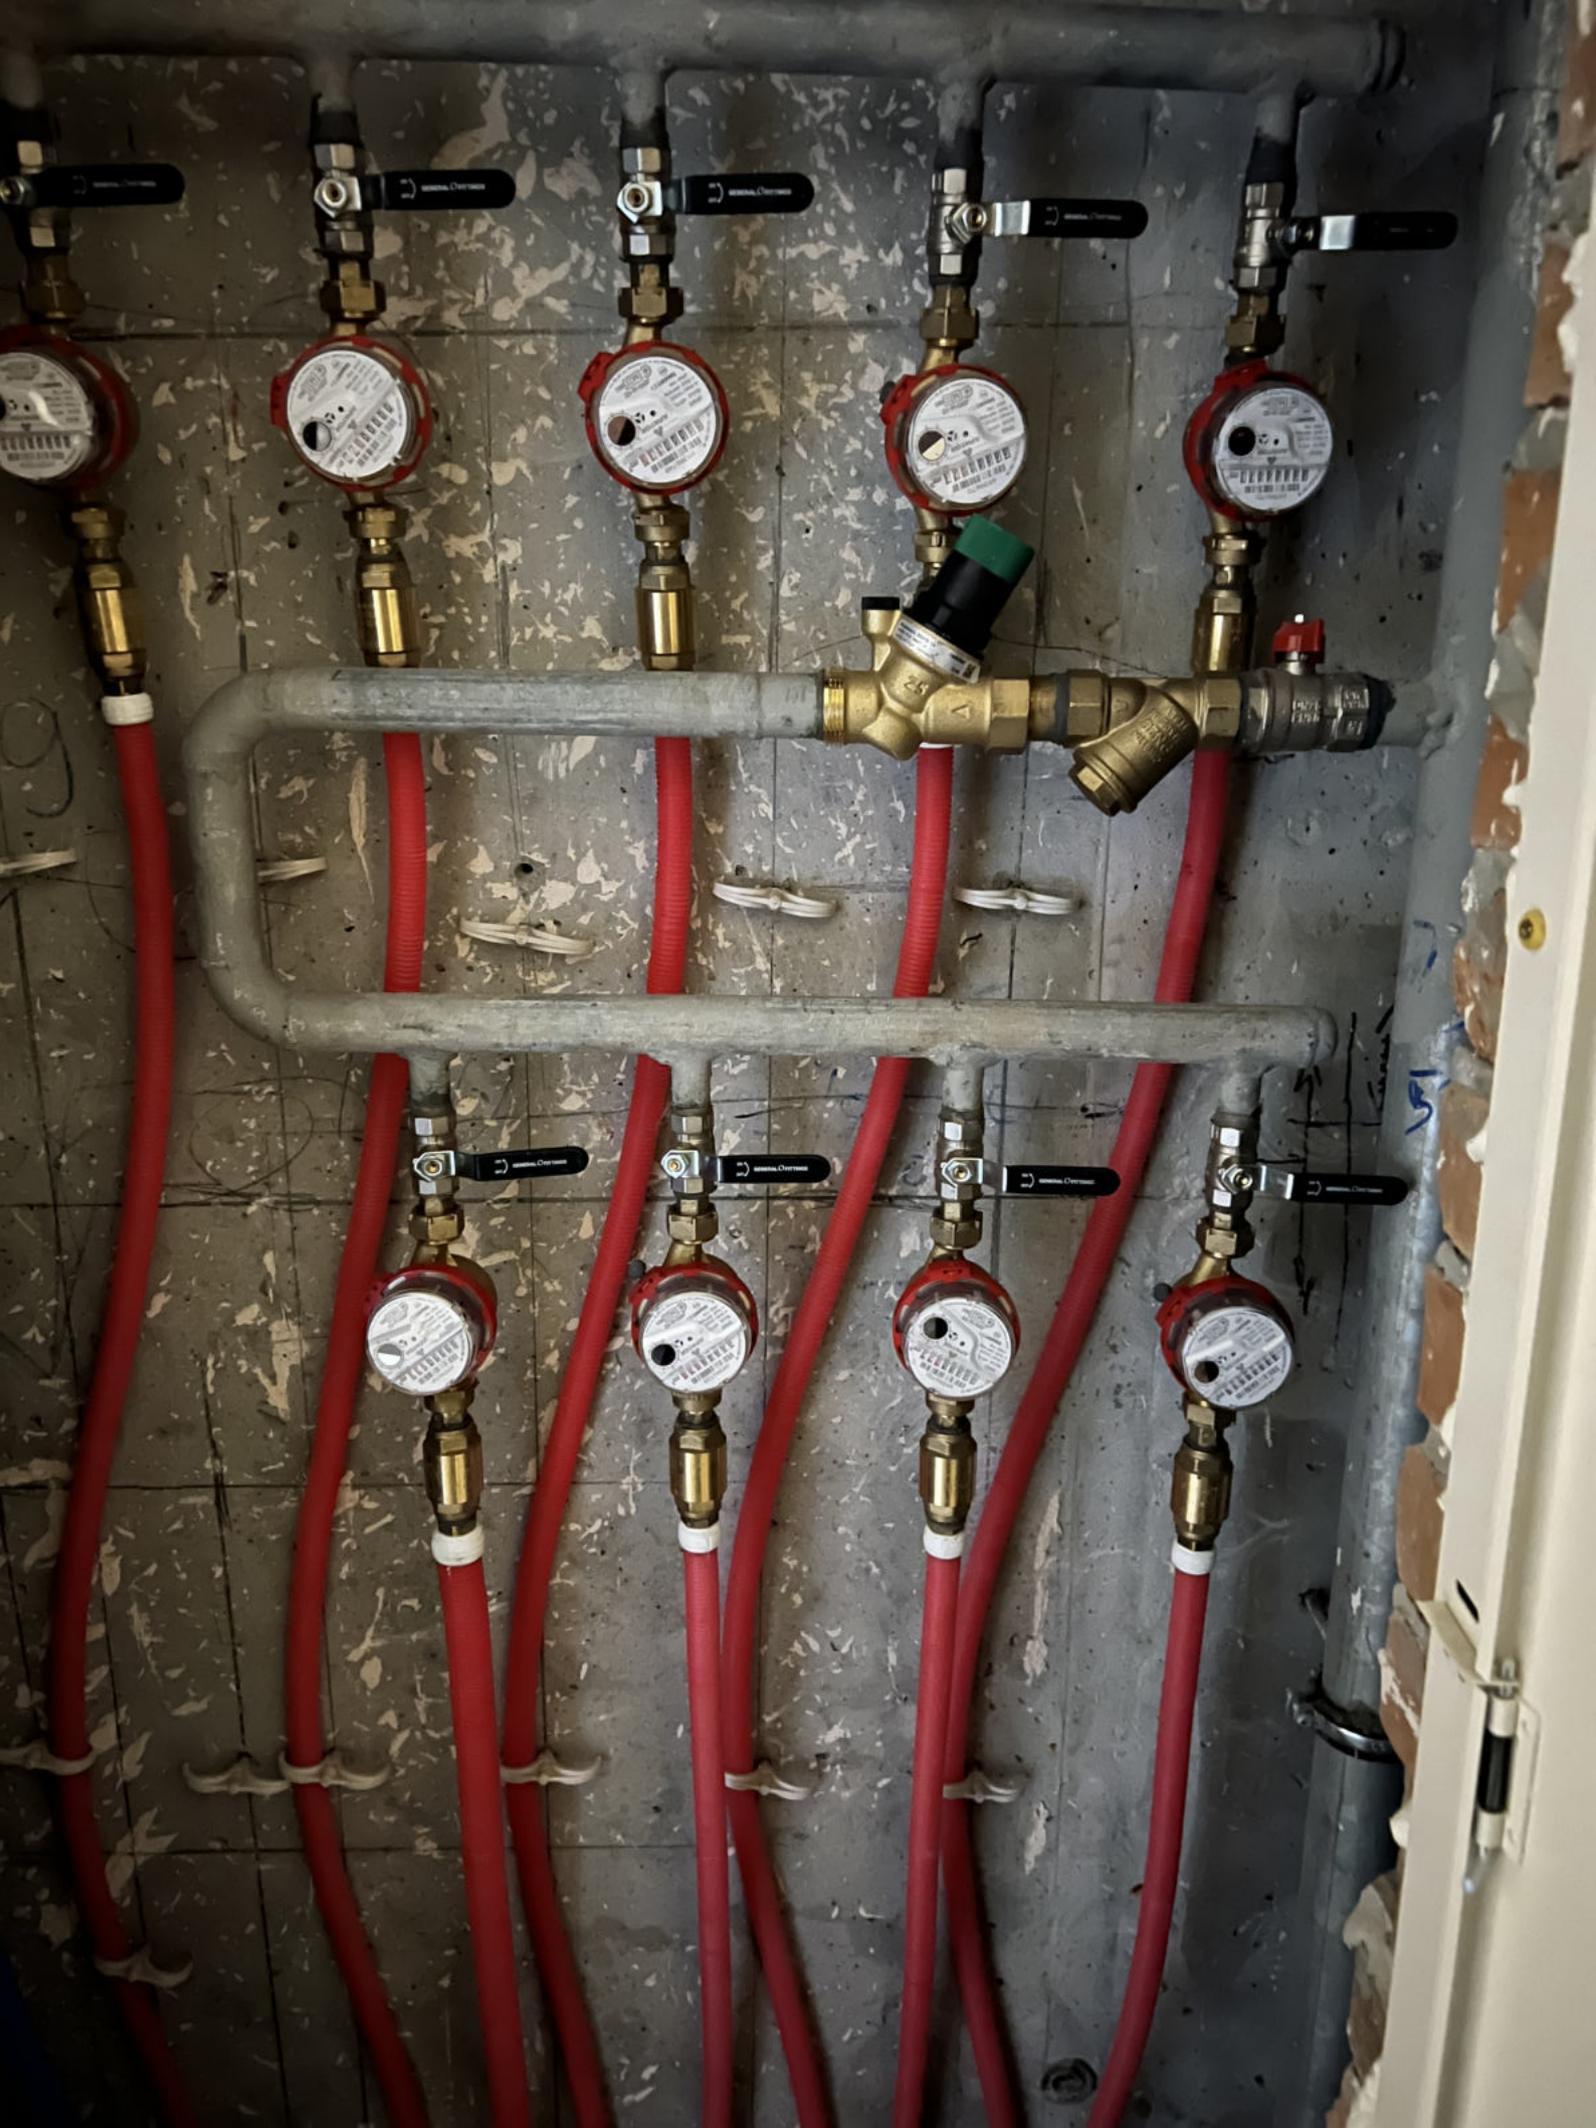





ПОВЕРА

2



1700 1200

37T

150

28.07

T1

150





ВИХІД

ПОЖЕЖА



16







ВИХІД






КОЛЯСОЧНА
МАКЕДОНСКИ







ІНЖЕНЕРІ
СЕРВІС

ІНЖЕНЕРІ
СЕРВІС

ІНЖЕНЕРІ
СЕРВІС

Інженерний
сервіс
систем ГВП







WARNING
ELECTRICAL EQUIPMENT
DO NOT TOUCH



ЗАПУС

ПУСК СИСТЕМИ ДИМОВИДА

КС-50

03



LOWARA

LOWARA





























