







3

ВХІД





ВИХІД







ВХІД



ПОЖЕЖА

















ВИХІД
















1 ПОВЕРЬ
2 ПОВЕРЬ













14 ПОВЕРХ









10206

"ССК ТМ"
ВЕНТИЛЯТОР

VRAN6-071-DUF600-N-00750/4-Y1-1-R0-0
ТУ Укр. ДСТУ 3304:2005-020 2017
ІСД 4 про 24.058 №04:210110 Зам.ССК001773
Виготовлено в Україні

Пакувальник
Кашуба Станіслав

ВЕНТИЛЯТОР
VRAN6-071-DUF600-N
-00750/4-Y1-1-R0-0
Зам.: ССК001773 №: 219515
Дата 05.24
2 5 0 0 0 0 5 7 1 2 2 5 3

Поддон 12 410 от 23.05.24

Наименование	кол
VRAN6-071-DUF600-N-00750/4-Y1-1-R0-0	1
Размер 1 300x1 200x1 400 мм	
Значит ССК001773	

















10206

ССК ТМ
ВЕНТИЛЯТОР
VRAN6-071-DUF600-N-00750/4-Y1-1-L0-0
ТУ У 38.2-39358968-020.201
Заказ: 26.888 №мк: 219516 Фак: ССК001773
Виготовлено в Україні!


ВЕНТИЛЯТОР
VRAN6-071-DUF600-N
-00750/4-Y1-1-R0-0
Заказ: ССК001773
Дата: 05.24
№: 219516
2 500005 712260





ПОЖЕЖА



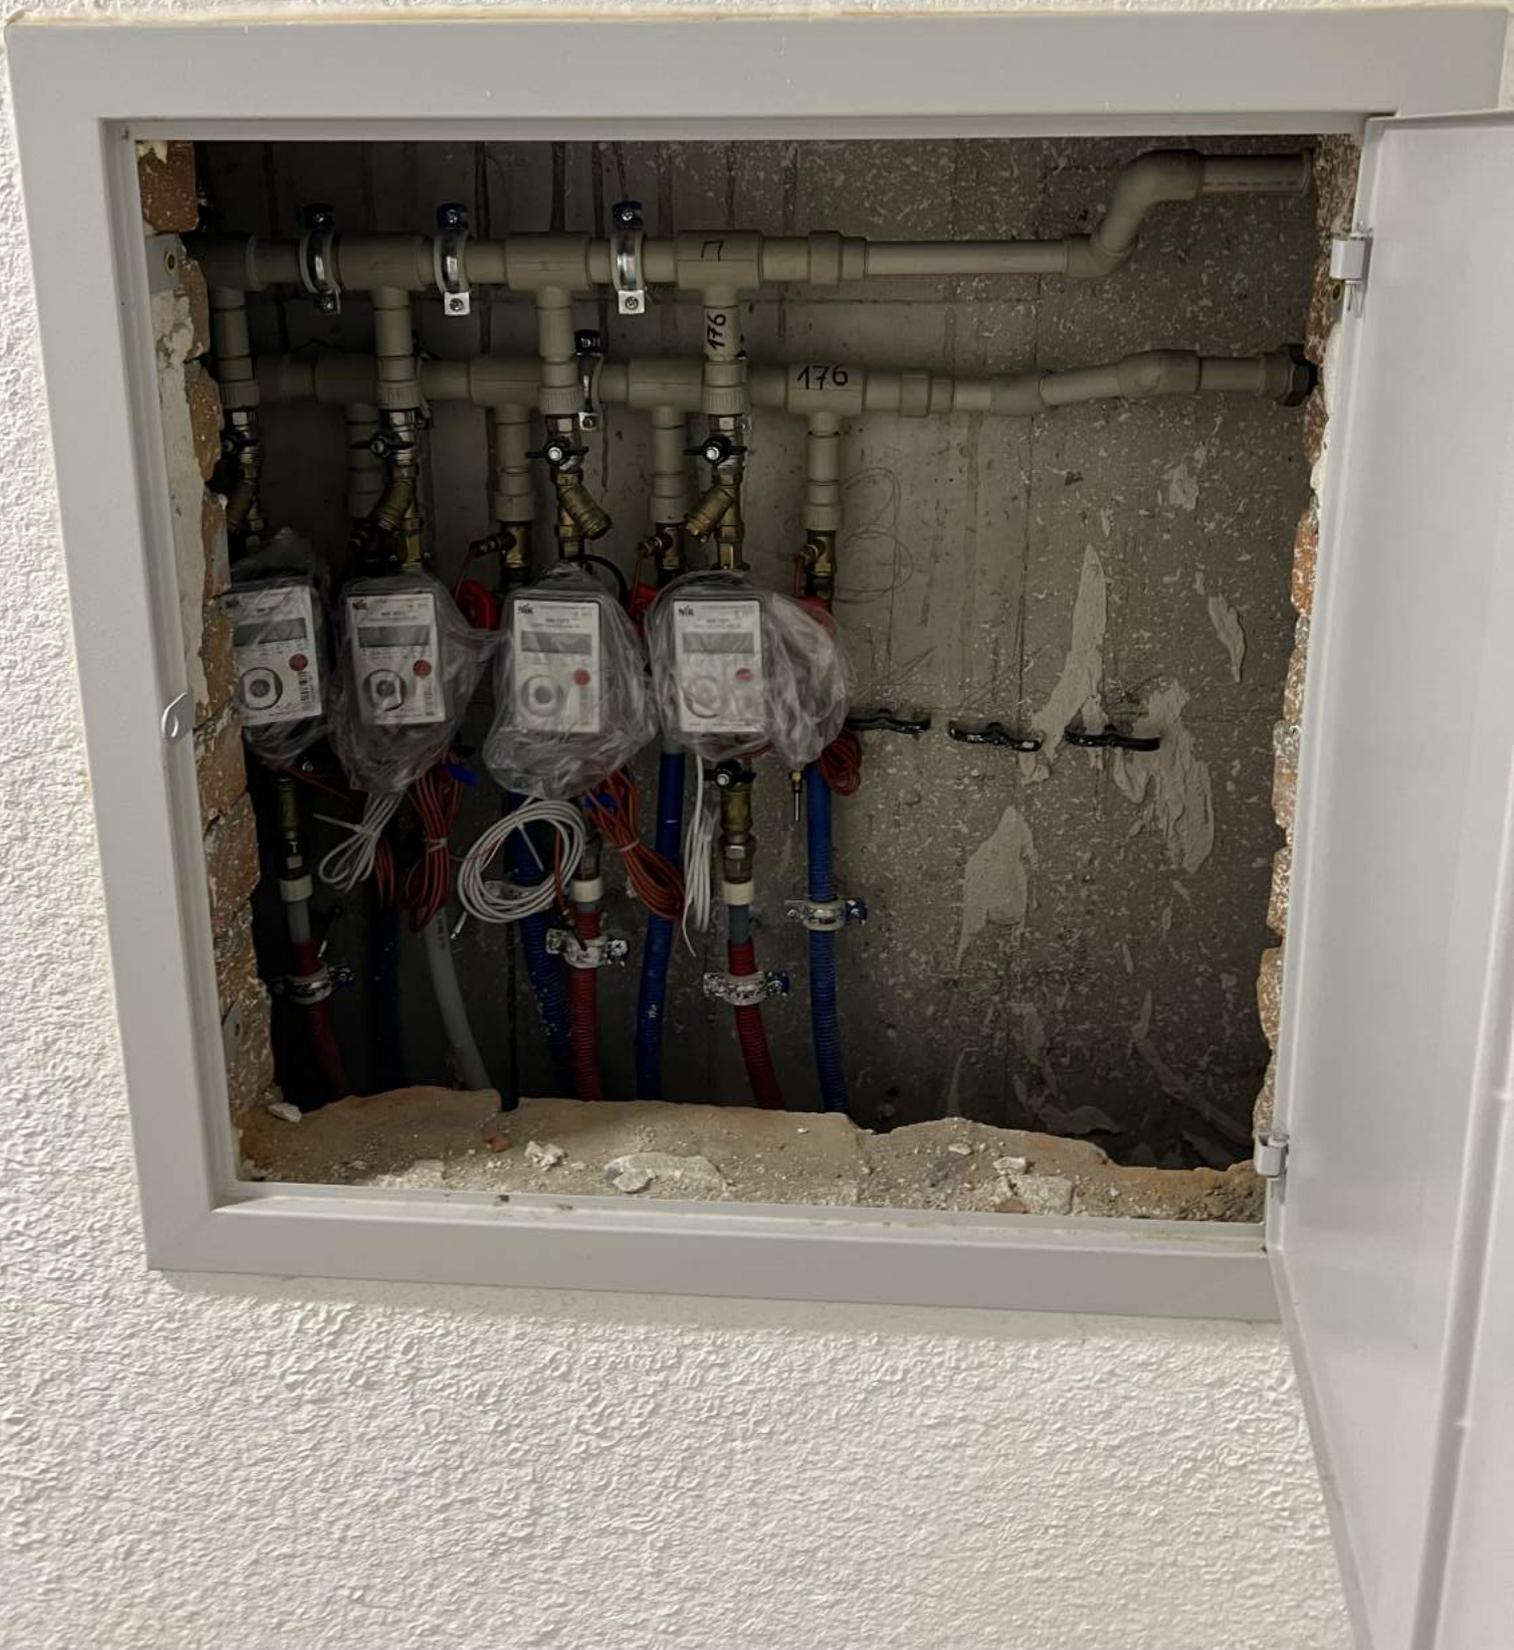



START

1-20-10-01122



Nik
172
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
173
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
174
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
175
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
176
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
177
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
178
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz

Nik
179
NK 2104 A PRT 1802 M 11
220 V 50/60 Hz



175



175

7

175

Nik
NK 7071
NK 7071









106 107 108 109 110 111

Niko 106
0.05788

Niko 107
07-06-24

Niko 108
0.00000

Niko 109

Niko 110

Niko 111











3

вход





ВКЛ

3













KONSTRUKTIONSBÜRO
K. GRAY 2164 6124
KÖLN 1992

001662.899 m

PERI







ВИХІД











БЕРИЦА

















21 22 23 24 25

21 22 23 24 25

NIK 21

NIK 22

NIK 23

NIK 24

NIK 25
















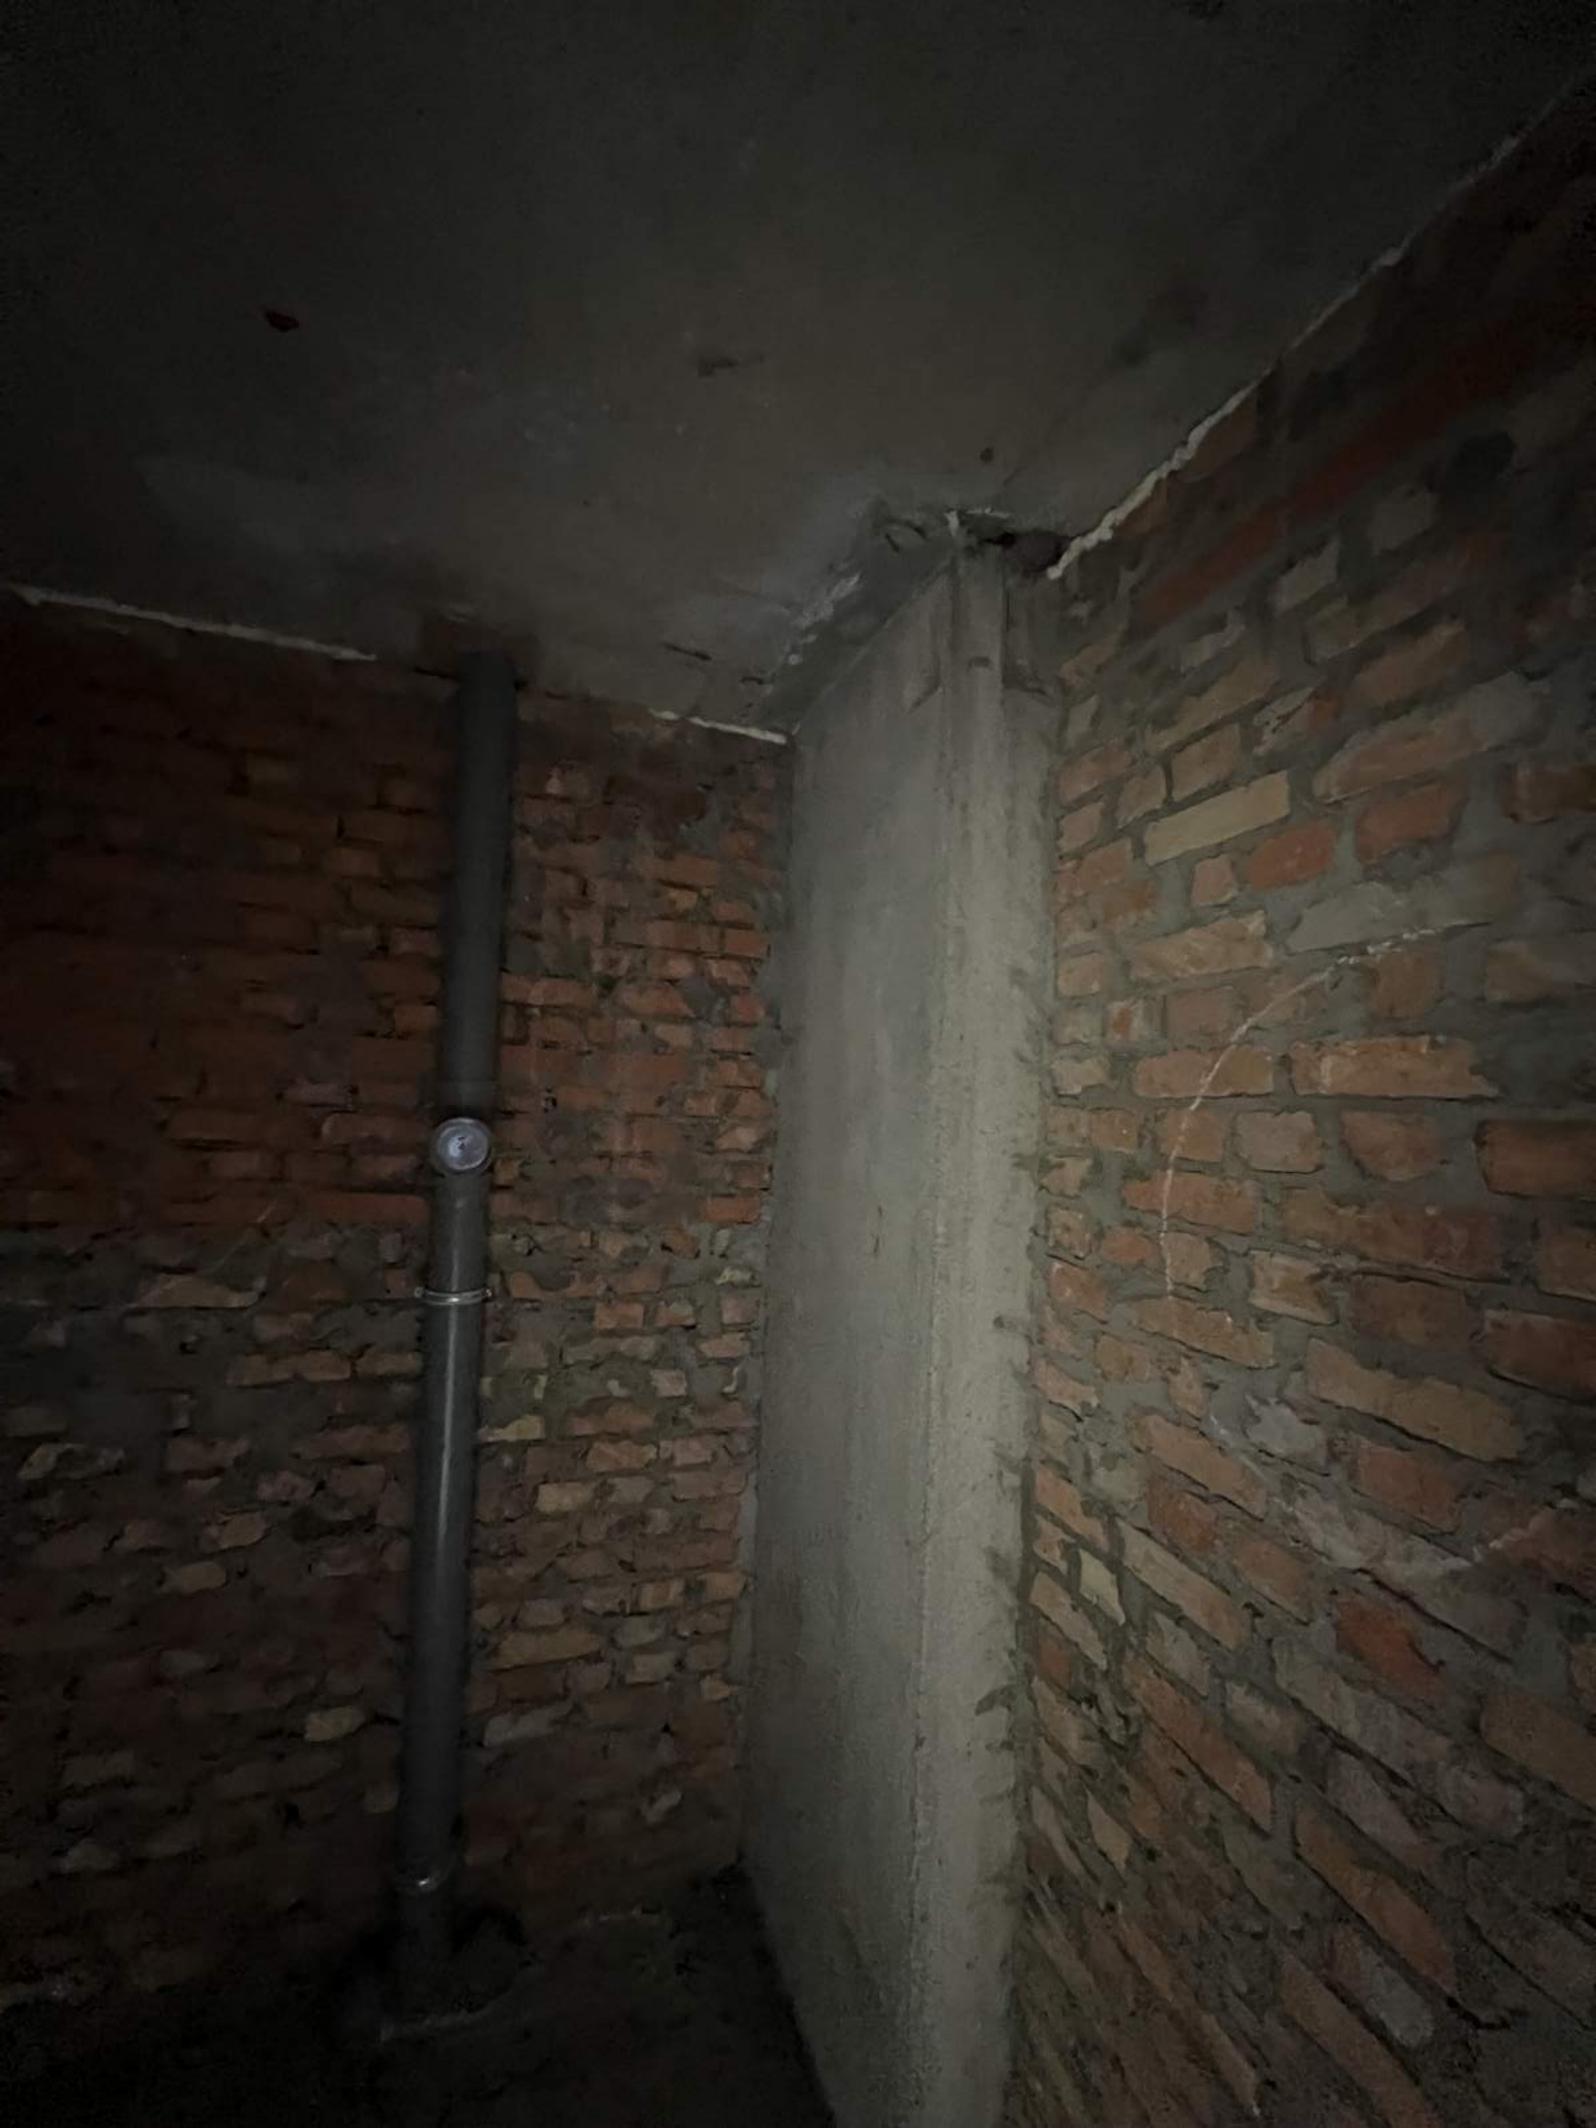





ГАЗ
ВИХОДЫ!



АВАРИЙНЕ
ОСВІТЛЕННЯ



ВИХІД



ВИХІД
←



УВАГА!

УКРИТТЯ

ВХІД





The image shows a wall-mounted electrical control panel with the following components:

- Top Row:** A black fire alarm control unit (TIRAS) on the left, followed by three white fire alarm control units (TIRAS).
- Second Row:** A white fire alarm control unit (TIRAS) on the left, followed by two white fire alarm control units (TIRAS).
- Third Row:** A white fire alarm control unit (TIRAS) on the left, followed by two white fire alarm control units (TIRAS).
- Bottom Row:** A white fire alarm control unit (TIRAS) on the left, followed by a red sign that reads "ГАЗ ВИХОДЬ!" (Gas Exit!), a white fire alarm control unit (TIRAS), and an orange sign that reads "АВАРИЙНЕ ОСВІТЛЕННЯ" (Emergency Lighting).

The panel is mounted on a wall with a textured, light-colored surface. A red L-shaped bracket is visible on the left wall. The ceiling is dark and appears to be made of concrete or a similar material. The floor is light-colored with yellow lines, suggesting a parking or industrial area.

**ГАЗ
ВИХОДЬ!**

**АВАРИЙНЕ
ОСВІТЛЕННЯ**



ВИХІД
EXIT

ВИХІД

ВИХІД
←







